


SHAMROCK ACRES

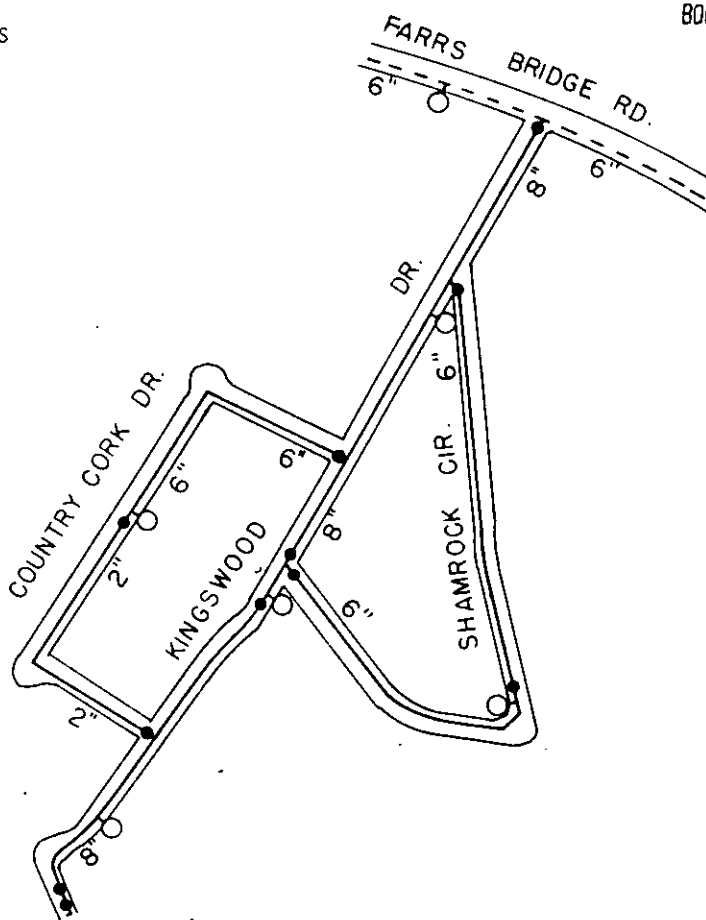

MATERIAL LIST

- 2,352'± - 8" Pipe
- 2,572'± - 6" Pipe
- 810'± - 2" Pipe
- 3 - 8" Valves
- 10 - 6" Valves
- 3 - 2" Valves
- 5 - Fire Hydrant

J. Frank Williams
 TO
 BEREA PUBLIC SERVICE DISTRICT
 Scale 1" = 400' December 1967

Recorded May 31, 1968 At 5:02 P.M. # 31119