


MATERIAL LIST:

- 2,107 ft 6" C.I. Pipe
- 945 ft 4" C. I. Pipe
- 2 6" Valves
- 1 4" Valve

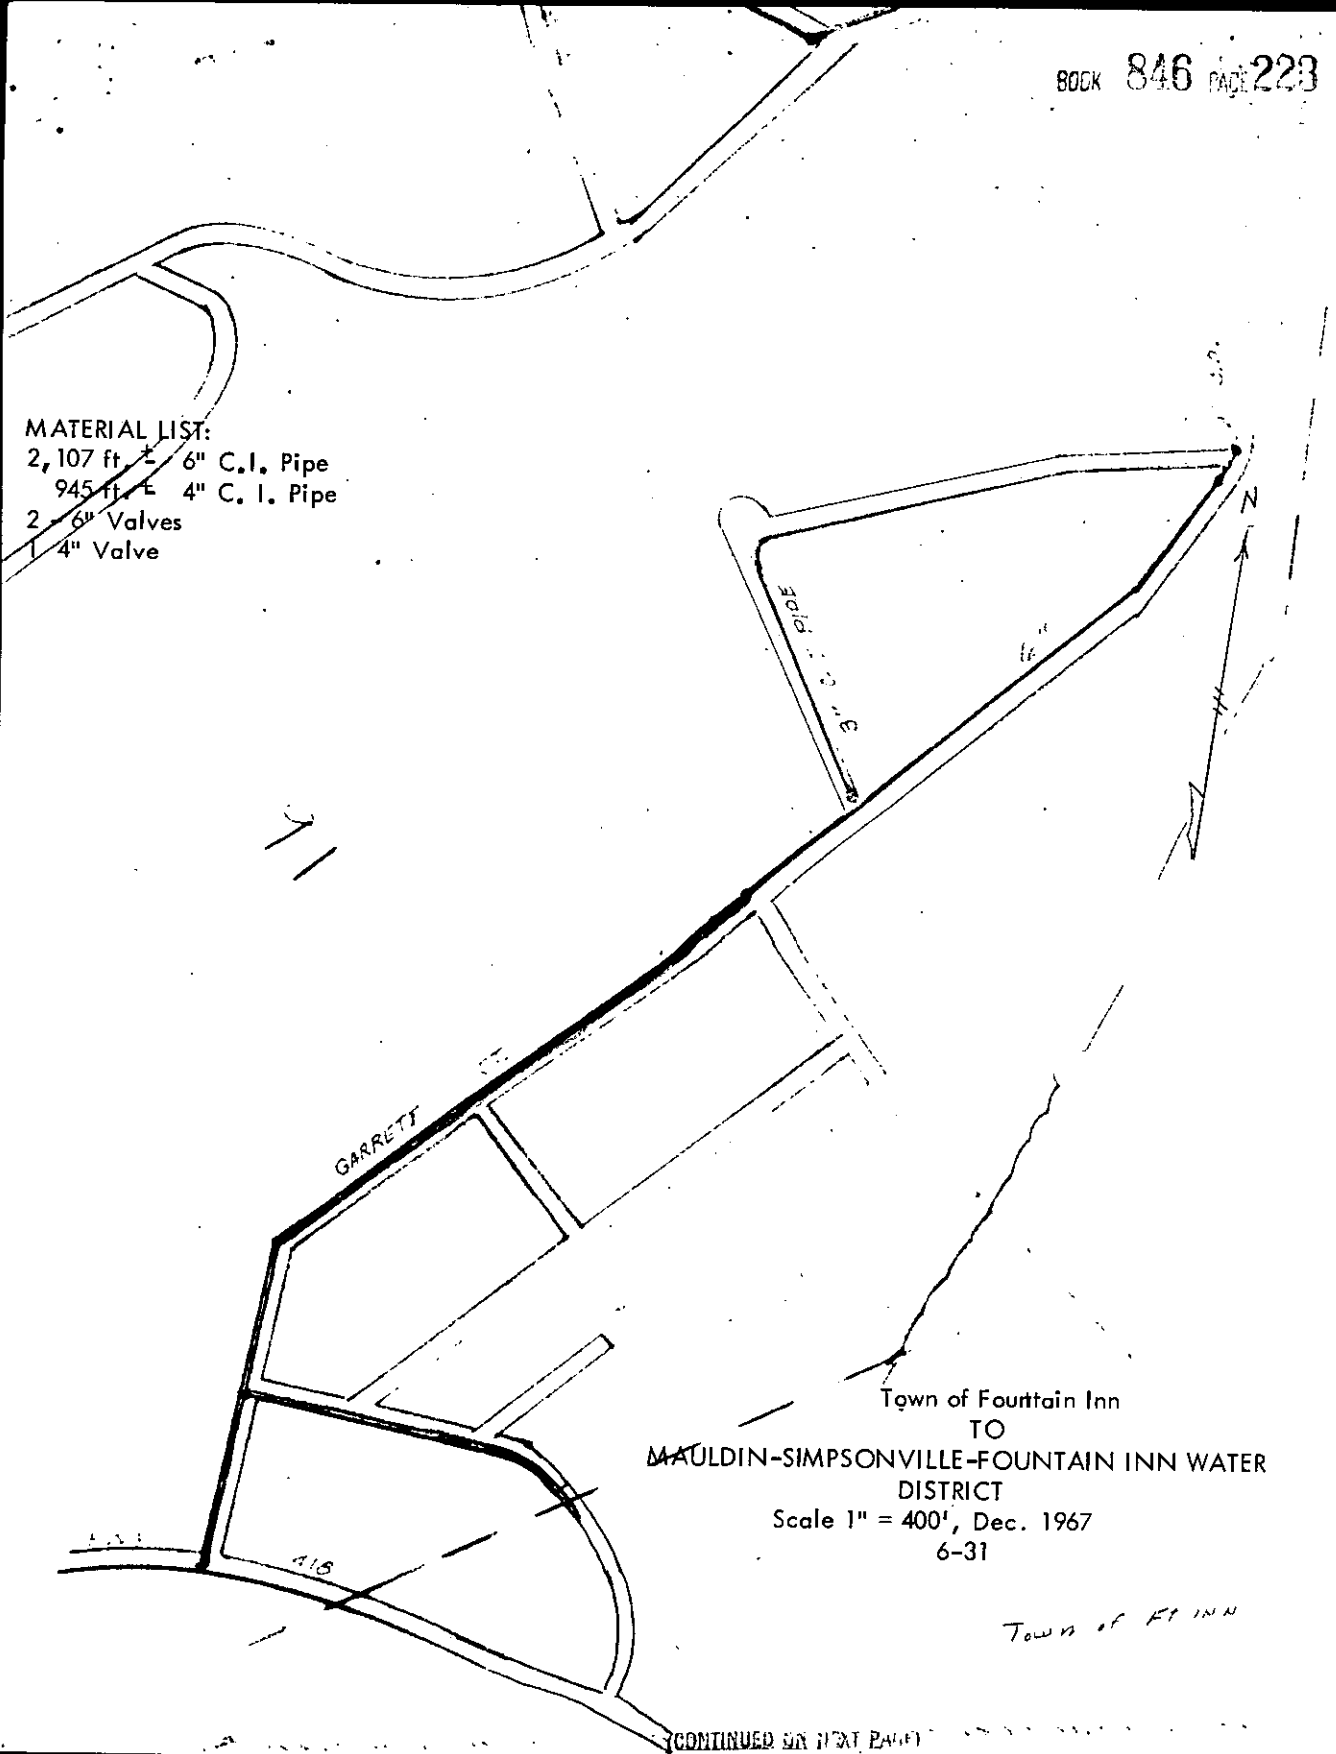

Town of Fountain Inn
TO
MAULDIN-SIMPSONVILLE-FOUNTAIN INN WATER
DISTRICT

Scale 1" = 400', Dec. 1967
6-31

Town of Fountain Inn

(CONTINUED ON NEXT PAGE)