


SCALE 1"=100'

N

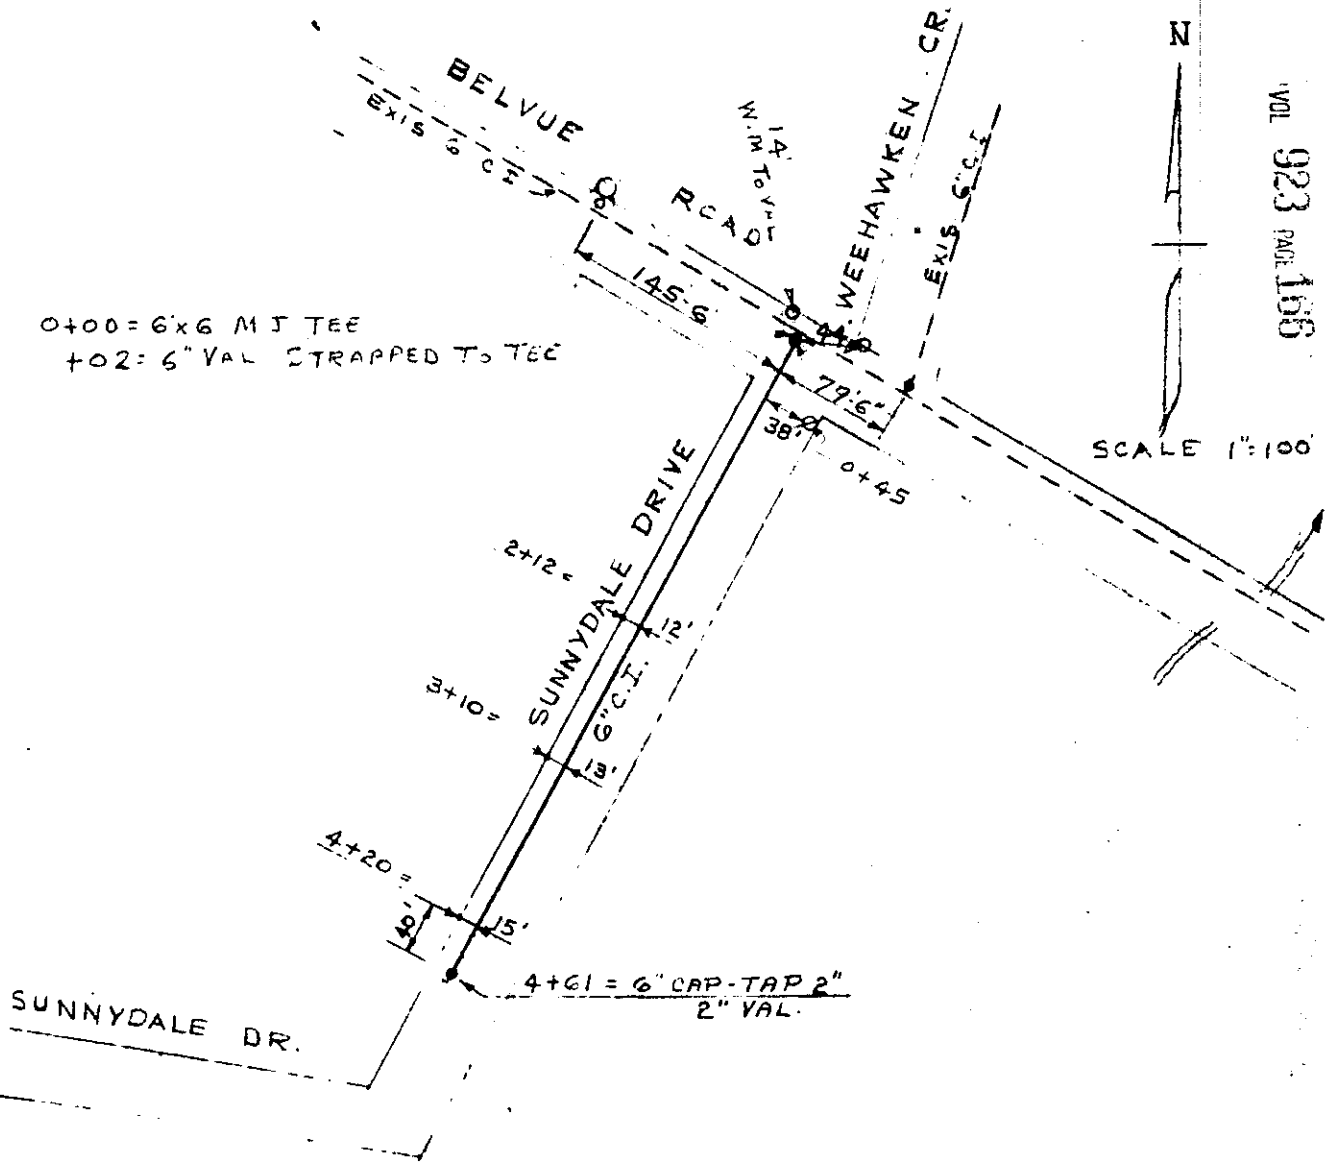

SUNNYDALE DR.

Material List

- 450' of 6" C. I. Pipe
- 1 - 6" Valve
- 1 - 2" Valve

H. O. Moody
 to
 Piedmont Park Fire District
 July 19, 1971

Recorded August 19, 1971 At 10:13 A.M. # 5162