




SCALE 1"=400'

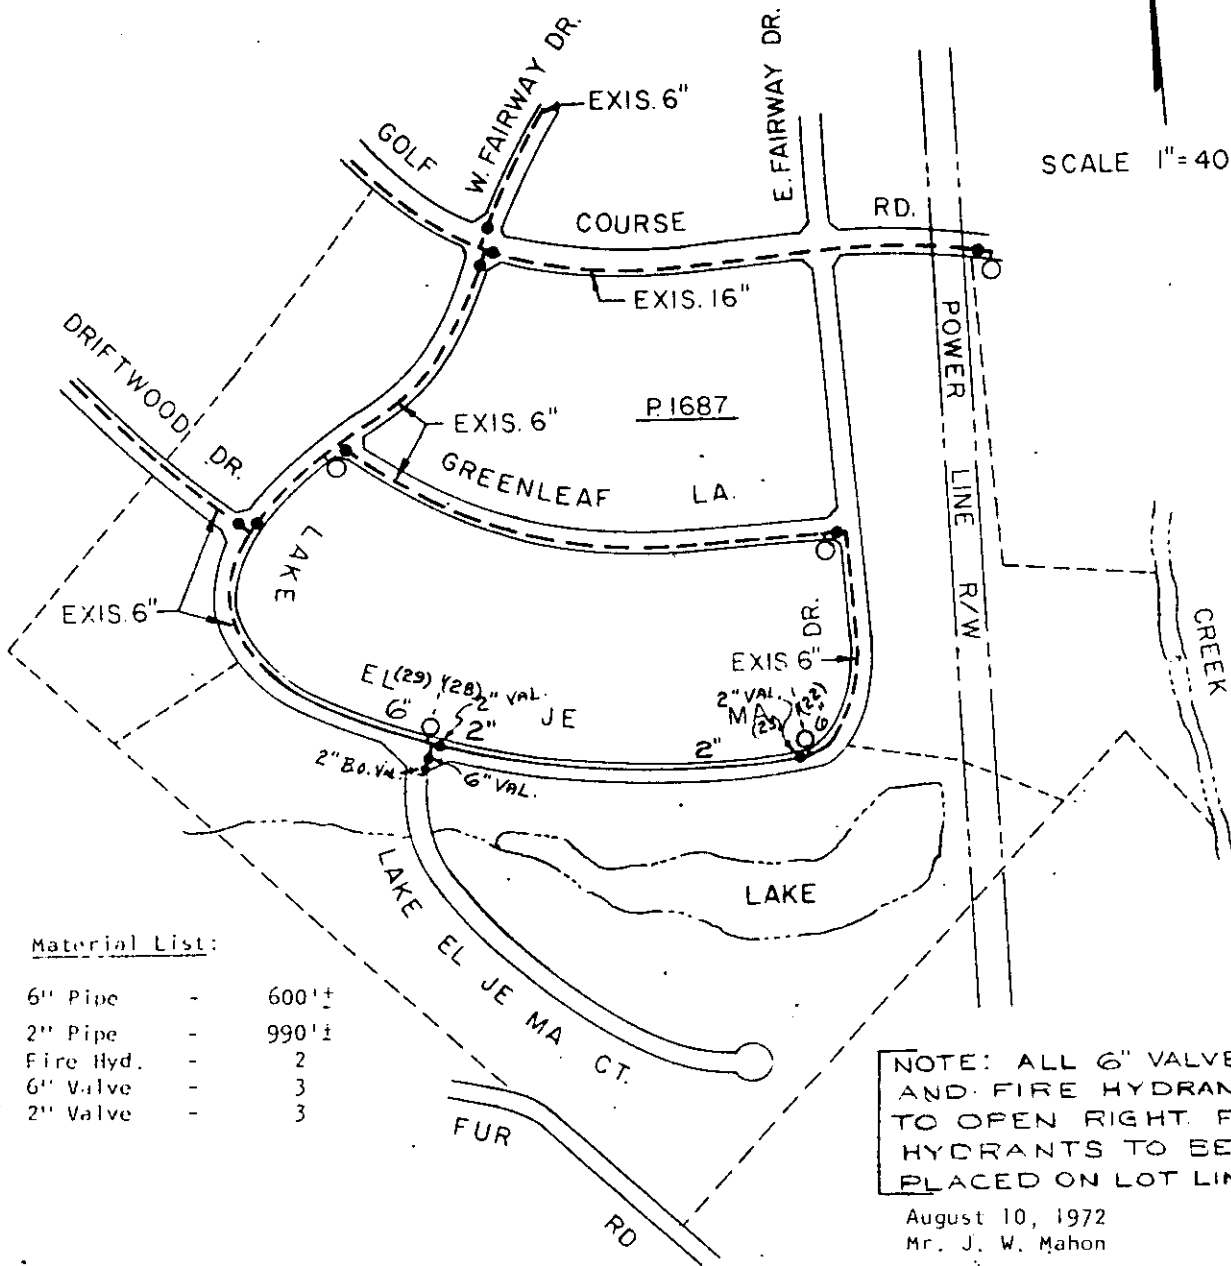

Material List:

6" Pipe	-	600'±
2" Pipe	-	990'±
Fire Hyd.	-	2
6" Valve	-	3
2" Valve	-	3

NOTE: ALL 6" VALVES AND FIRE HYDRANTS TO OPEN RIGHT. FIRE HYDRANTS TO BE PLACED ON LOT LINES.

August 10, 1972
 Mr. J. W. Mahon
 to
 City of Greenville

ADDITION TO SEC. NO. 2 BELLE TERRE ACRES

APRIL, 1972

Plat Recorded January 3, 1973 at 4:29 P.M., # 19001