


0606

REMOVED 2' BOV, PLUGGED 3" LINE AND
TIED IN TO EXISTING 8" LINE

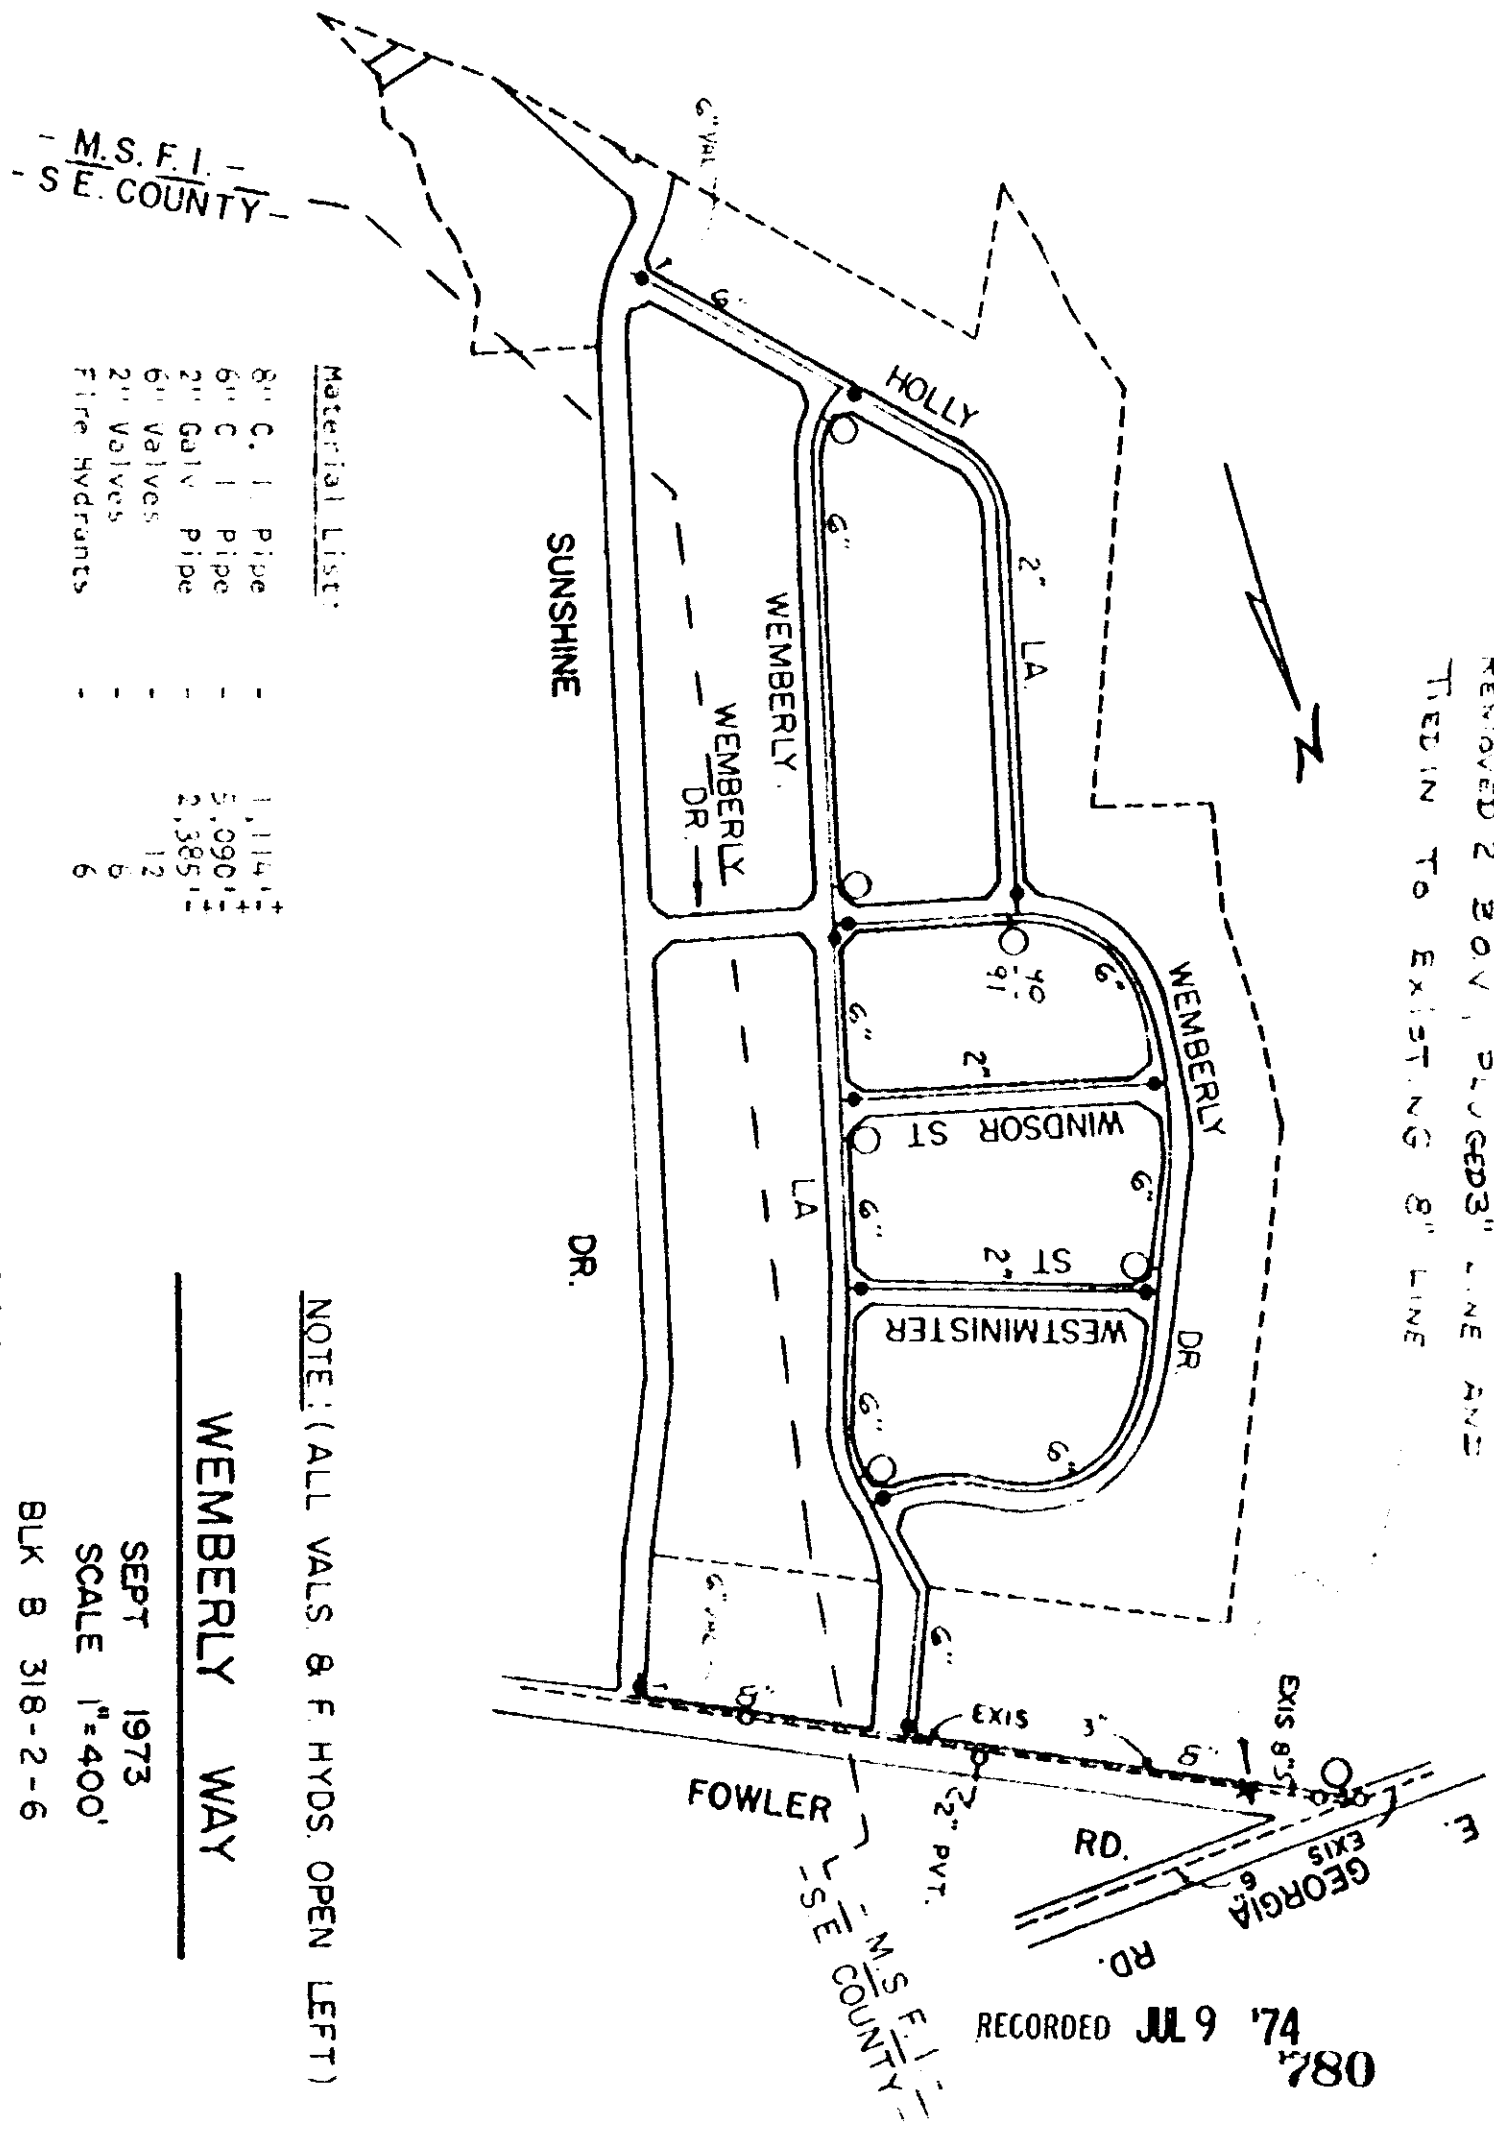

Material List:

8" C. I. Pipe	1,114'
6" C. I. Pipe	5,090'
2" Galv. Pipe	2,385'
6" Valves	12
2" Valves	6
Fire Hydrants	6

NOTE: (ALL VALS & F. HYDS. OPEN LEFT)

WEMBERLY WAY

SEPT 1973
SCALE 1"=400'

BLK B 318-2-6
Tri-Co Investments, Inc.

Commissioners of Public Works
of the City of Greenville, S. C.
June 24, 1974

RECORDED JUL 9 '74

4328 RV-2