
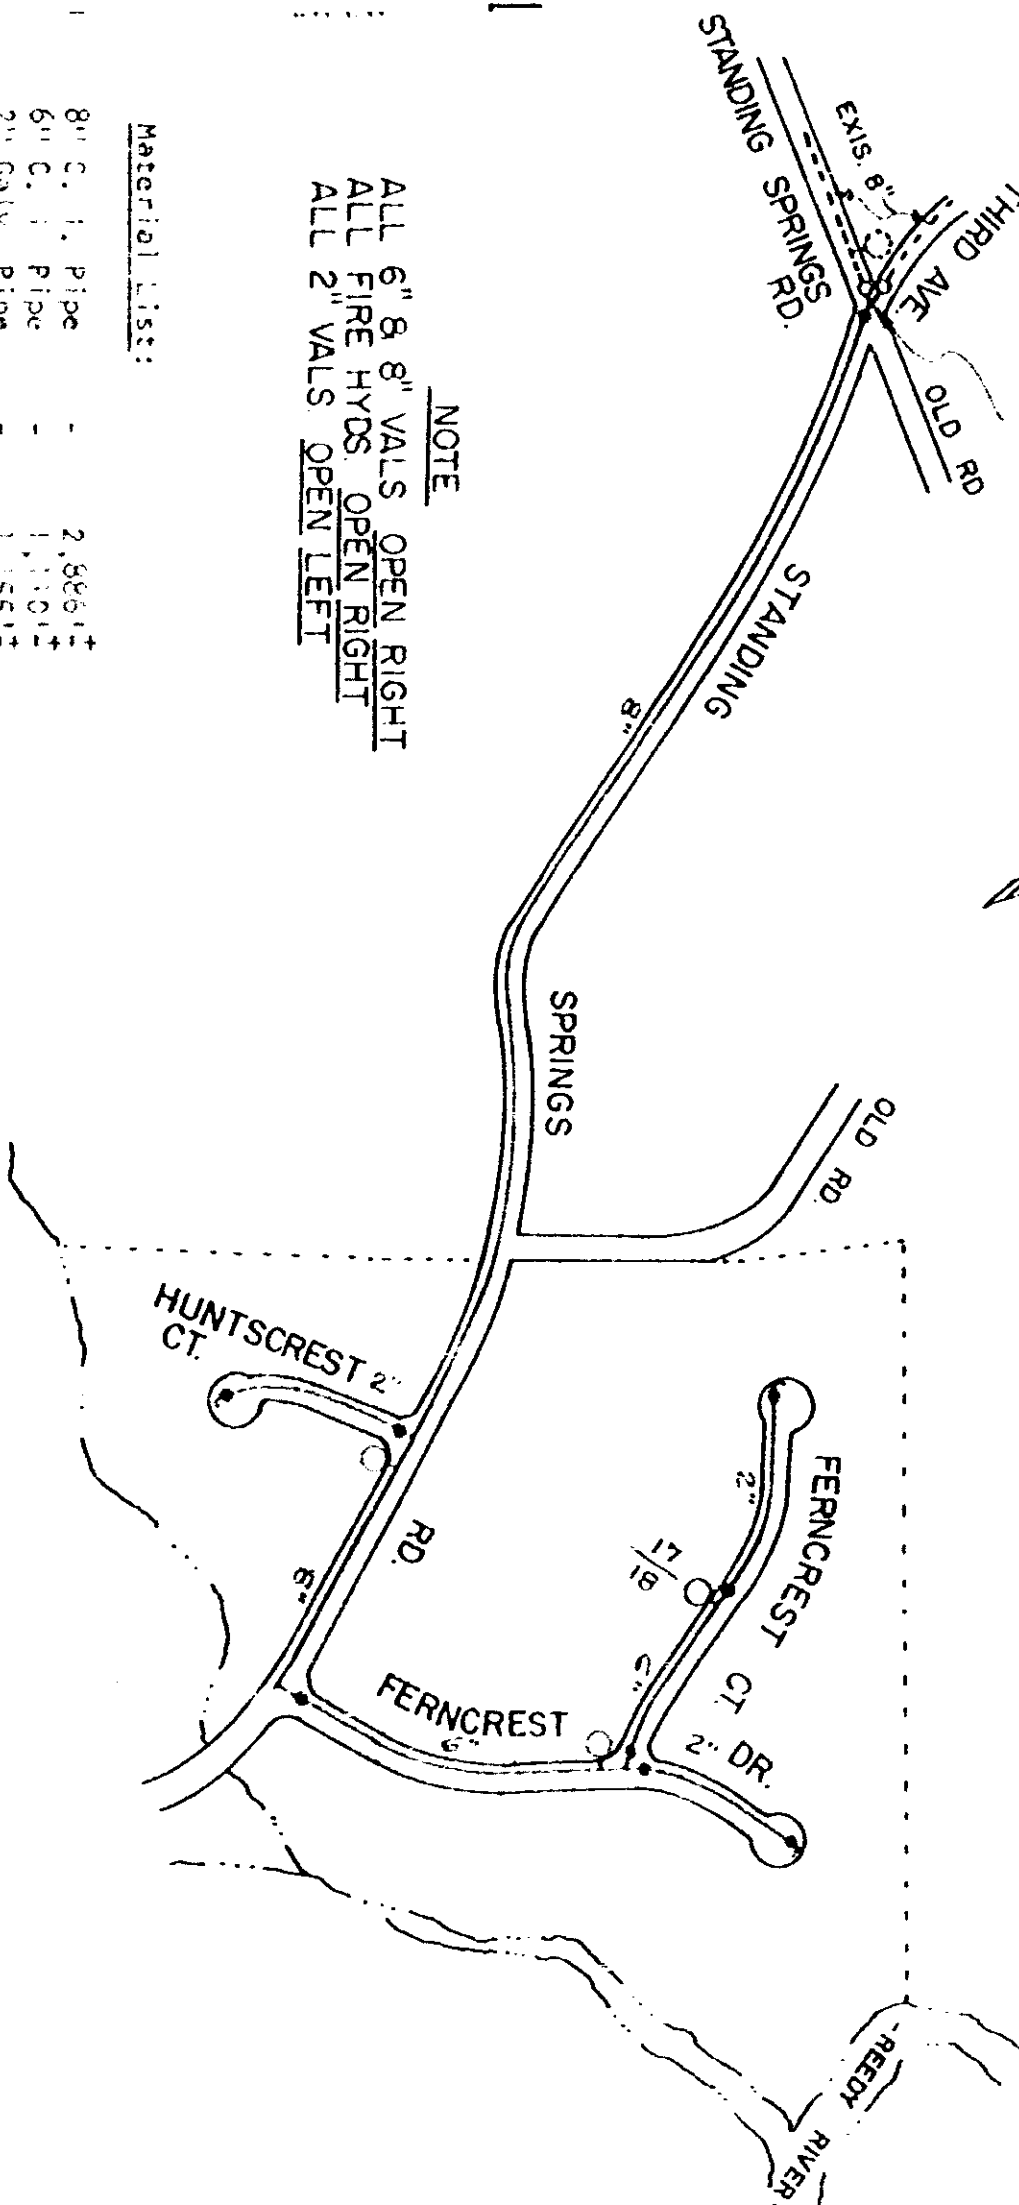


Vol. 1002 PAGE 876

EXIS. 8" x 8" TEE

SCALE 1"=400'



NOTE
 ALL 6" 8" 8" VALS OPEN RIGHT
 ALL FIRE HYDS. OPEN RIGHT
 ALL 2" VALS OPEN LEFT

Material List:

8" C. I. Pipe	2,886'
6" C. I. Pipe	1,110'
2" Galv. Pipe	1,155'
8" Valve	1
6" Valves	5
2" Valves	6
Fire Hydrants	3

RECORDED JUL 12 74 1292

FERNCREEK SUBD.

OCT., 1973 BLK. B. 415-1-9
 Robert C. West
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 June 25, 1974