


0474

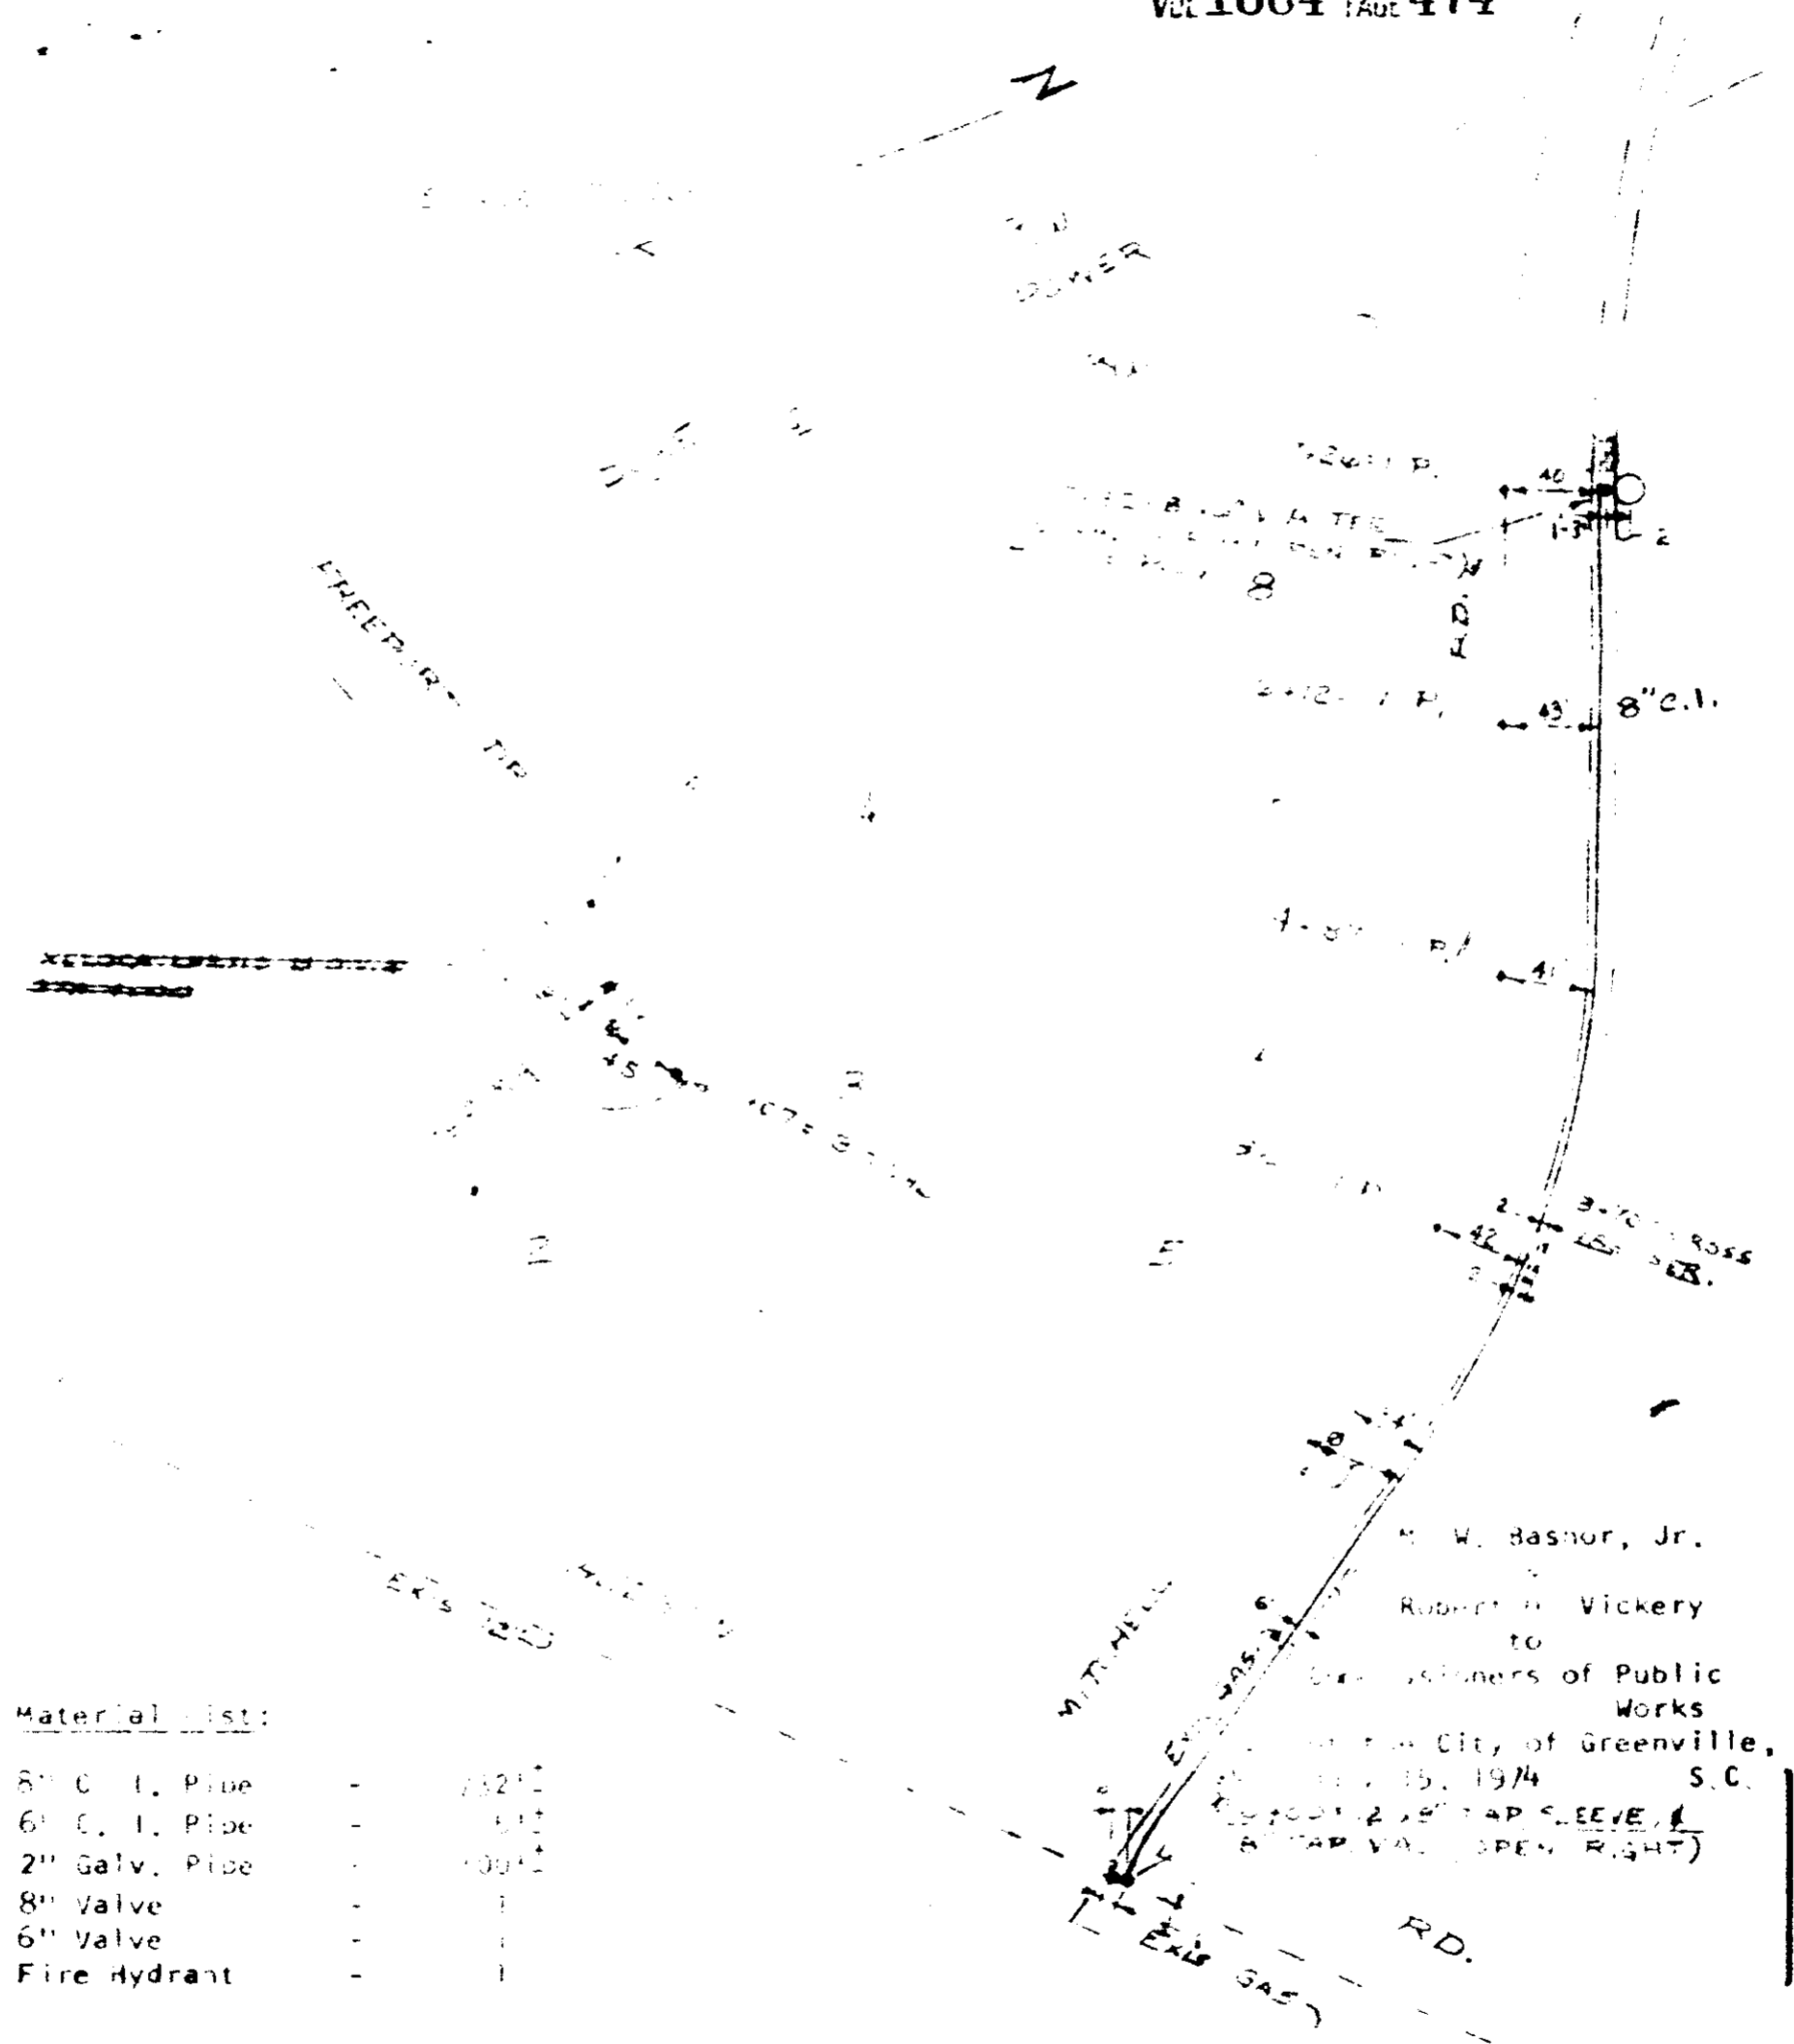

Material List:

8" C. I. Pipe	-	732'
6" C. I. Pipe	-	61'
2" Galv. Pipe	-	100'
8" Valve	-	1
6" Valve	-	1
Fire Hydrant	-	1

M. W. Bashor, Jr.  
 Robert H. Vickery  
 to  
 Commissioners of Public Works  
 City of Greenville,  
 S.C.  
 AUG 15, 1974  
 (2" TAP SLEEVE &  
 6" TAP VALVE OPEN RIGHT)

**PILGRAMS POINT ADD.**

BLK B 543 3-1-22 RECORDED AUG 8 '74 3921

4328 RV.2