


BOOK 1010 PAGE 724

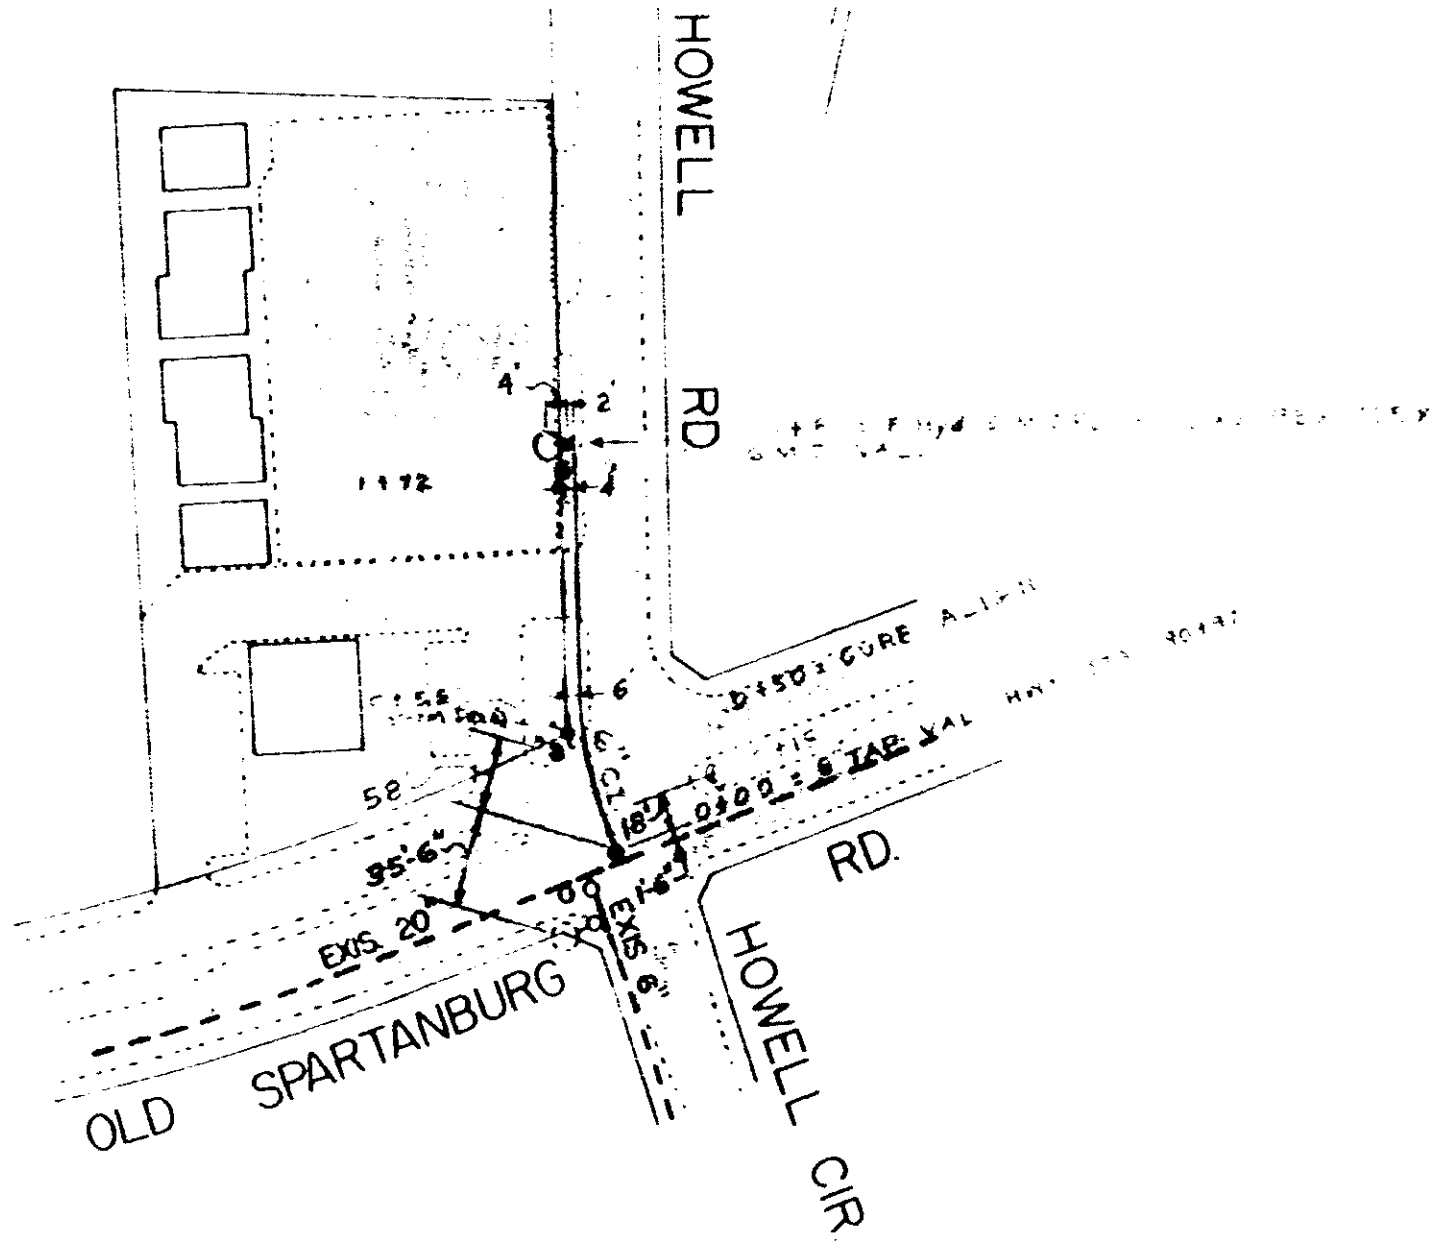

NOTE

ALL 6" VALS & FIRE HYDS OPEN RIGHT

Material List.

6" C. I. Pipe	-	166'
6" Valves	-	2
Fire Hydrant	-	

HOWELL RD.

JUNE, 1974 SCALE 1"=100'

BLK BK 5413-1-17 & 18

Threatt-Maxwell Enterprises, Inc.
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 November 5, 1974

RECORDED NOV 22 '74 13096

0724

13096