


9594

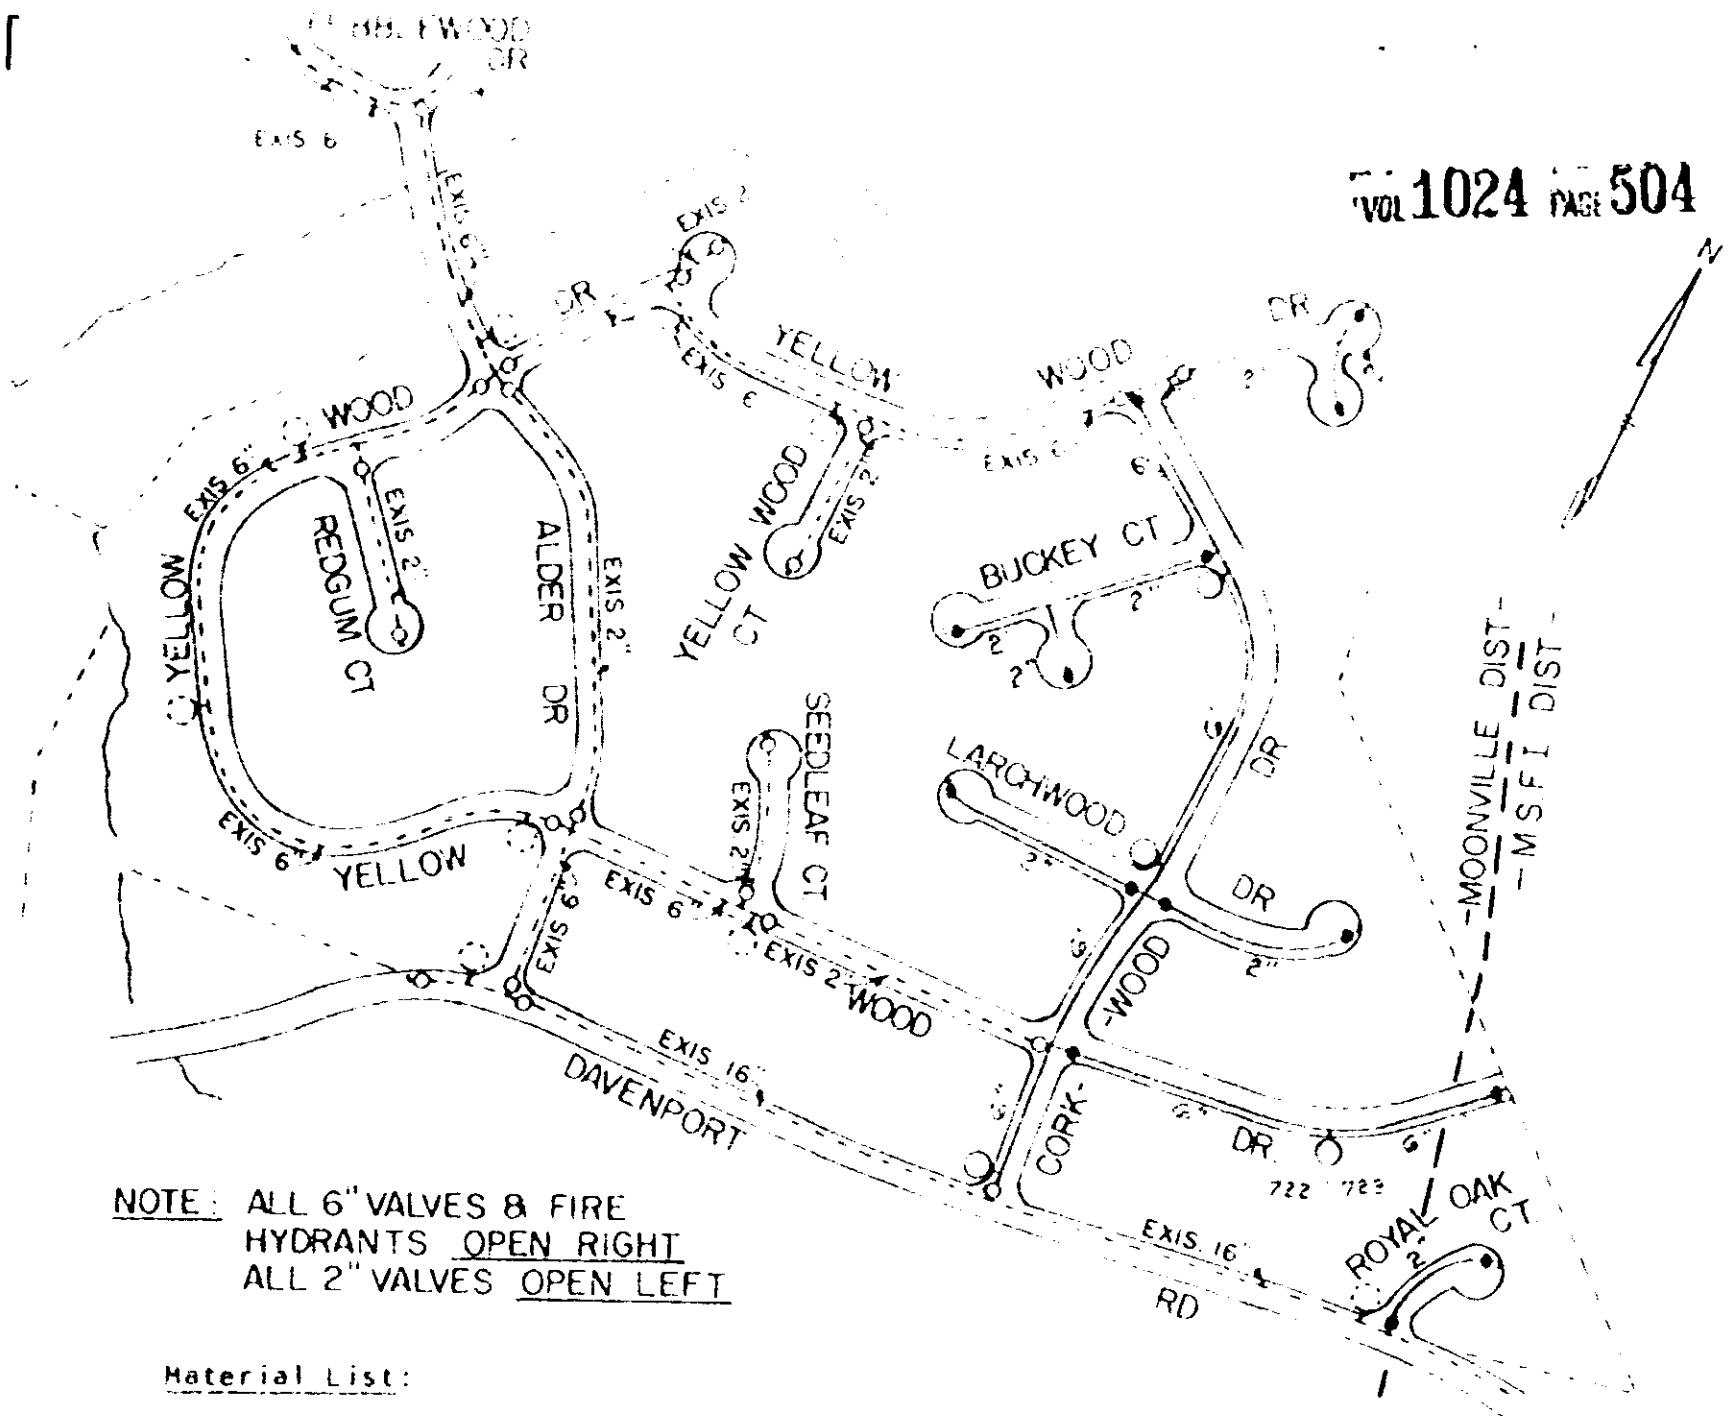

NOTE: ALL 6" VALVES & FIRE
HYDRANTS OPEN RIGHT
ALL 2" VALVES OPEN LEFT

Material List:

6" C. I. Pipe	-	2,690'
2" Galv Pipe	-	2,485'
6" Valves	-	6
2" Valves	-	12
Fire Hydrants	-	4

WESTWOOD, SEC. 6

AUGUST 1975 SCALE 1"=400'
 BK BOOK 574 2-1-20 & 566 2-1-2
 Builders & Developers, Inc.
 Commissioners of Public Works
 of the City of Greenville, S. C.
 August 20, 1975

RECORDED SEP 19 '75

At 11:03 A.M.

7477

4328 RV-2