


0095

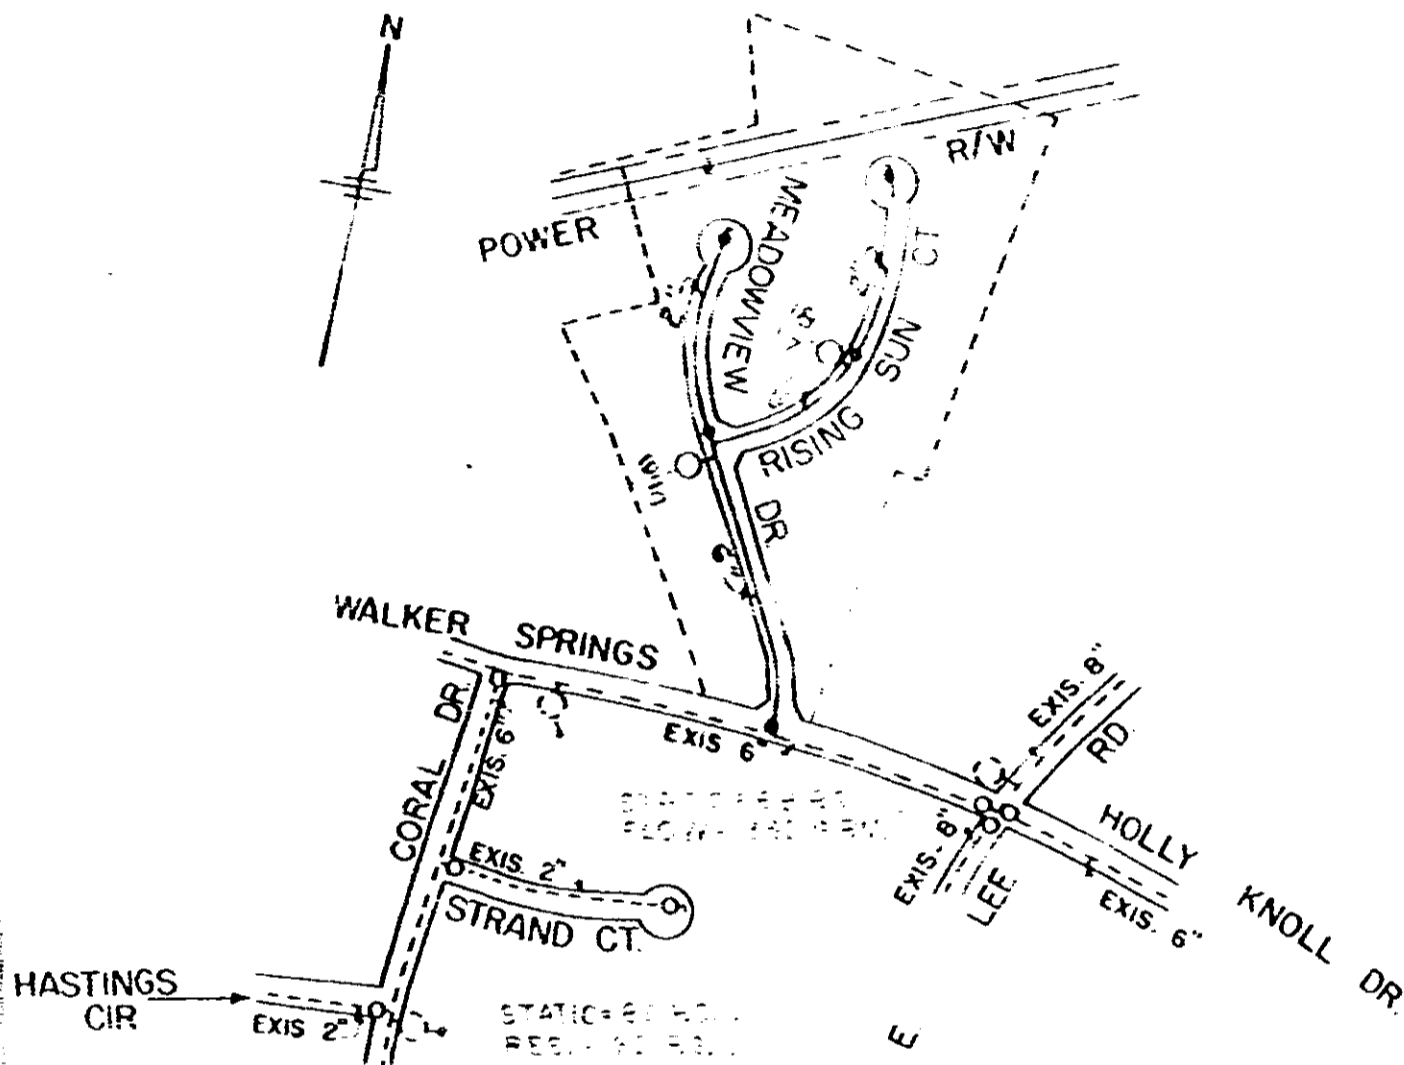

NOTE ALL 6" VALVES OPEN RIGHT.
 ALL 2" VALVES OPEN LEFT.
 ALL FIRE HYDRANTS TO BE 3-WAY & OPEN RIGHT.

MATERIAL LIST:

6" C. I. Pipe	-	340'
2" Galv. Pipe	-	225'
6" Valves	-	3
2" Valves	-	4
Fire Hydrants	-	2

THE MEADOWS

JUNE, 1976 SCALE 1"=400

NOV., 1976

United Development Services, Inc.
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 November 11, 1976

BLK. B. T31-1-1

14862

RECORDED DEC 1 '76 At 2:34 P.M.

4328 RV-2