


NOTE: ALL 6" & 8" VALVES TO OPEN RIGHT  
ALL FIRE HYDRANTS TO BE 3-WAY & OPEN RIGHT

Material List:

8" C. I. Pipe	-	2,954.1'
6" C. I. Pipe	-	491.1'
8" Valve	-	1
6" Valves	-	4
Fire Hydrants	-	4

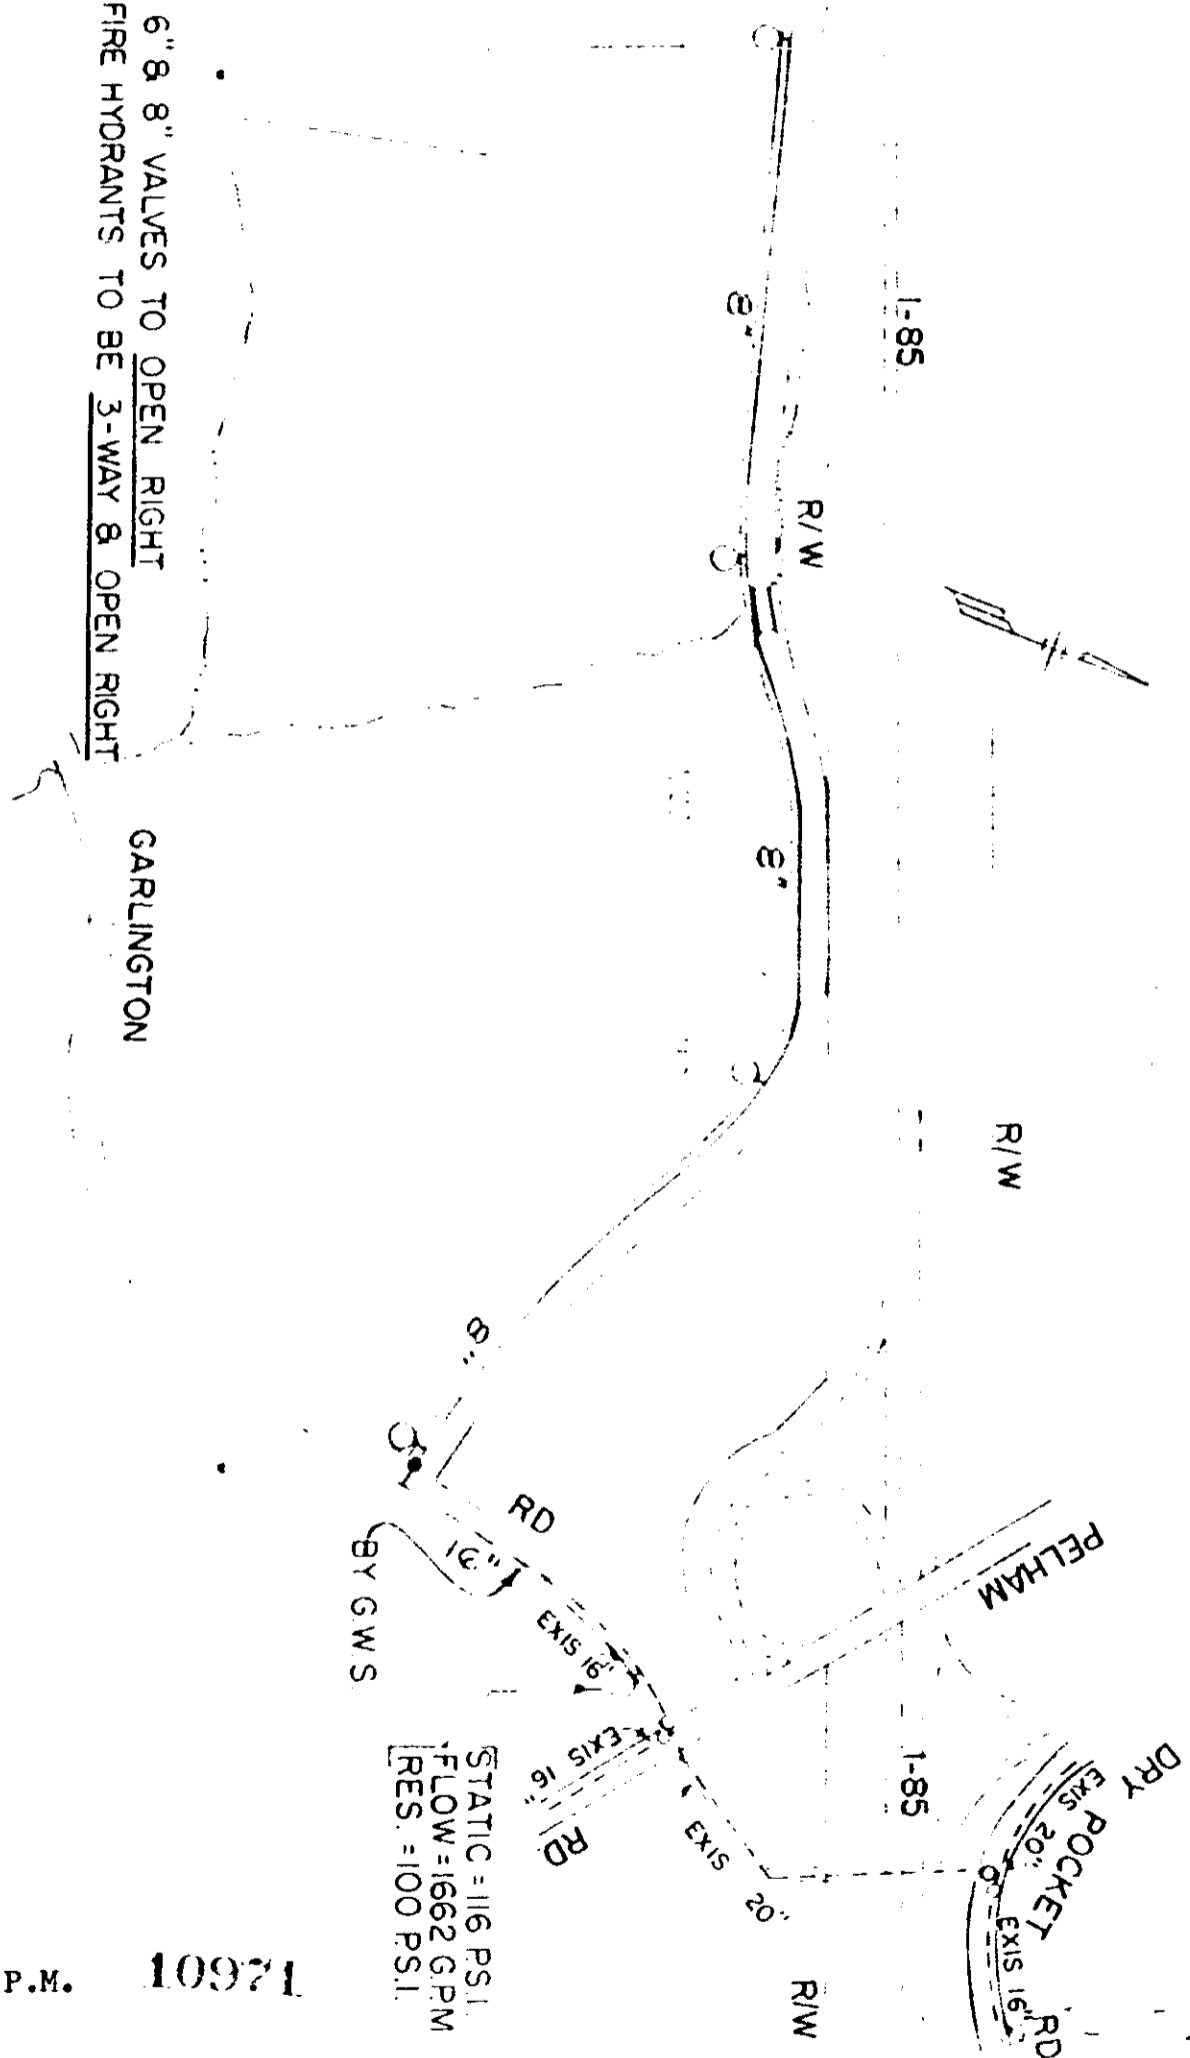

STATIC = 116 PS.I.  
 FLOW = 1662 G.P.M.  
 RES. = 100 PS.I.

GARLINGTON

GARLINGTON RD. INDUSTRIAL PARK

JUNE, 1975 SCALE 1"=400'

Archie L. Honbarrier  
 TO  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 August 29, 1977  
 Block Book 533.4-1-7

RECORDED OCT 6 1977 At 2:45 P.M. 10971