


1066 PAGE 510

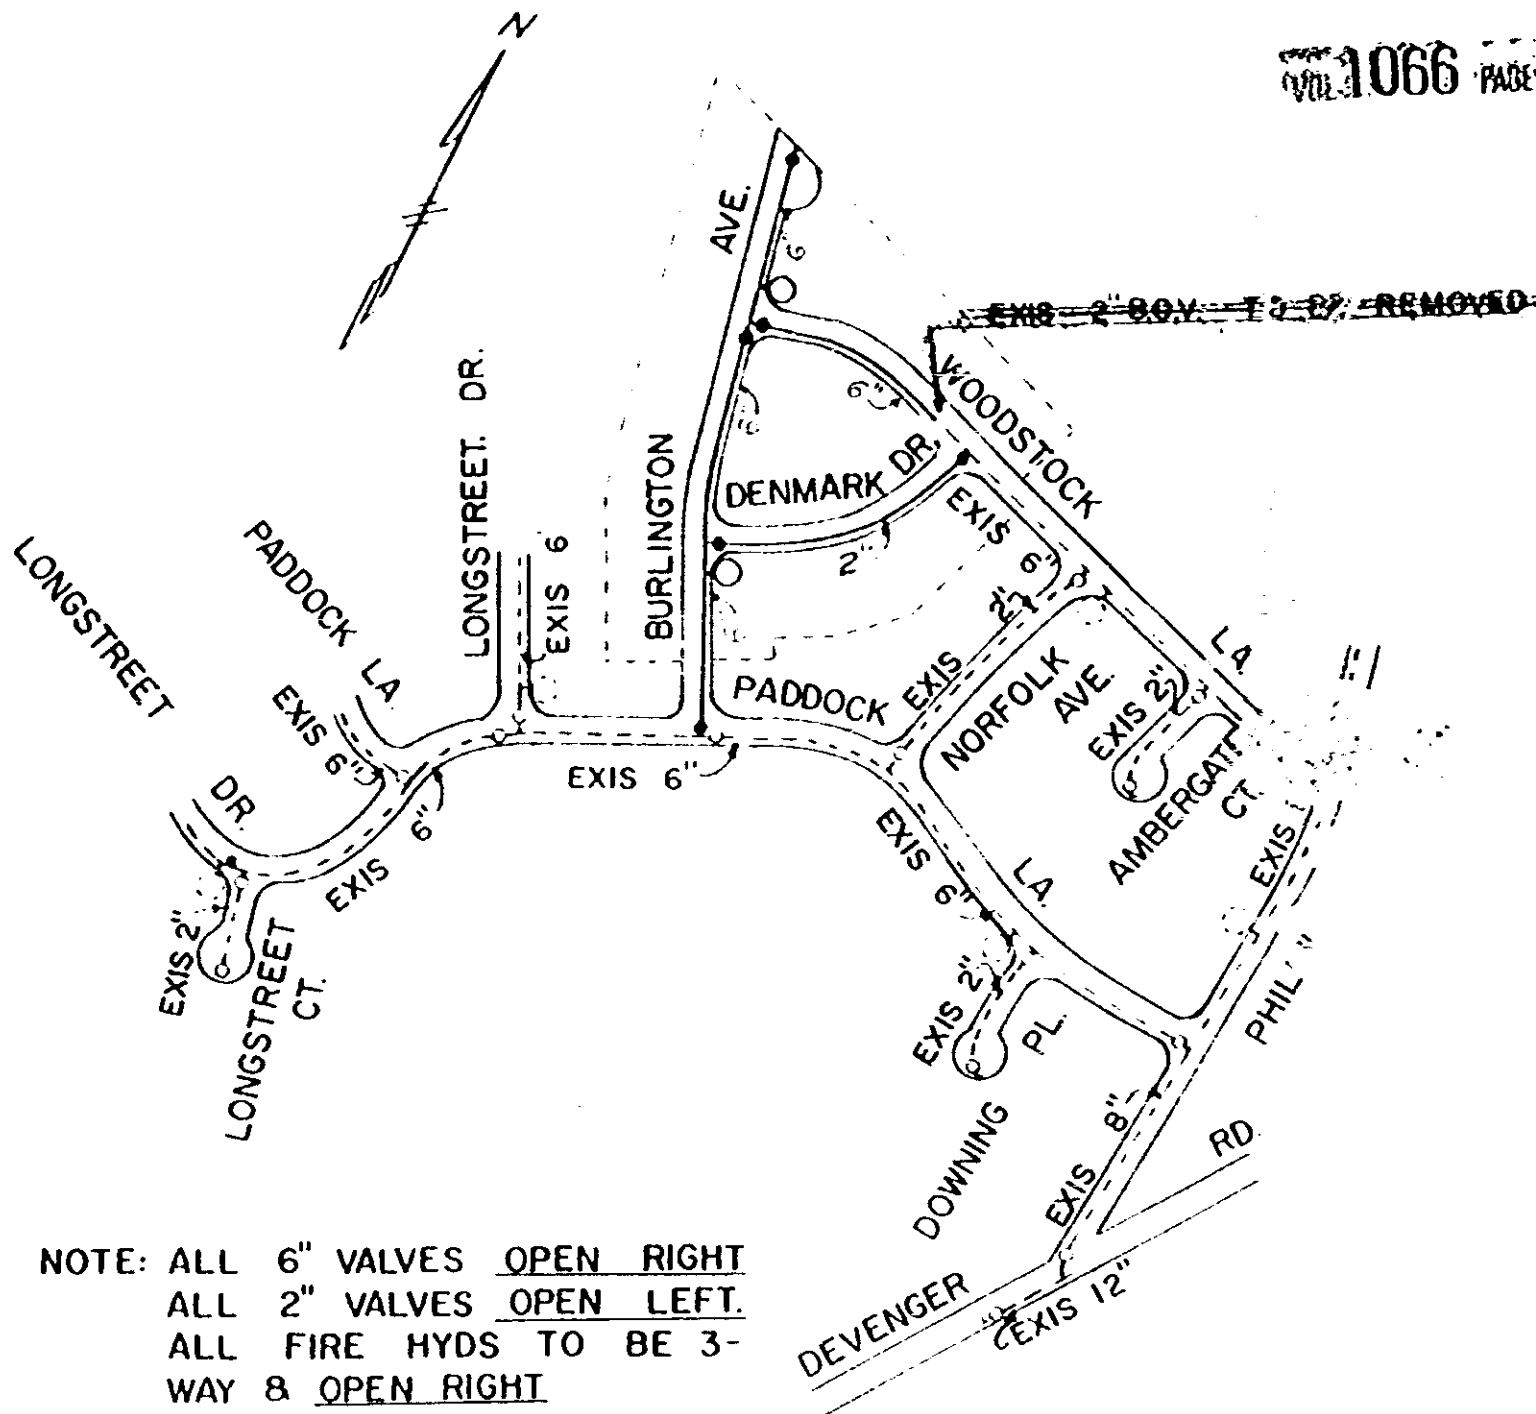

NOTE: ALL 6" VALVES OPEN RIGHT  
 ALL 2" VALVES OPEN LEFT.  
 ALL FIRE HYDS TO BE 3-  
 WAY & OPEN RIGHT

Material List:

|               |   |         |
|---------------|---|---------|
| 6" C. I. Pipe | - | 1,550'± |
| 2" Galv. Pipe | - | 530'±   |
| 6" Valves     | - | 5       |
| 2" Valves     | - | 3       |
| Fire Hydrants | - | 2       |

WESTMINSTER VILLAGE, SEC.-2

MARCH, 1977 SCALE 1" = 400'

BLK BK. 540.3-1-24

Westminster Company  
 to  
 Commissioners of Public Works  
 Of the City of Greenville, S. C.  
 September 28, 1977

Recorded October 10th., 1977 at 4:53 PM

11307

4328 RV-2

0519