


VCL 1067 CASE 723

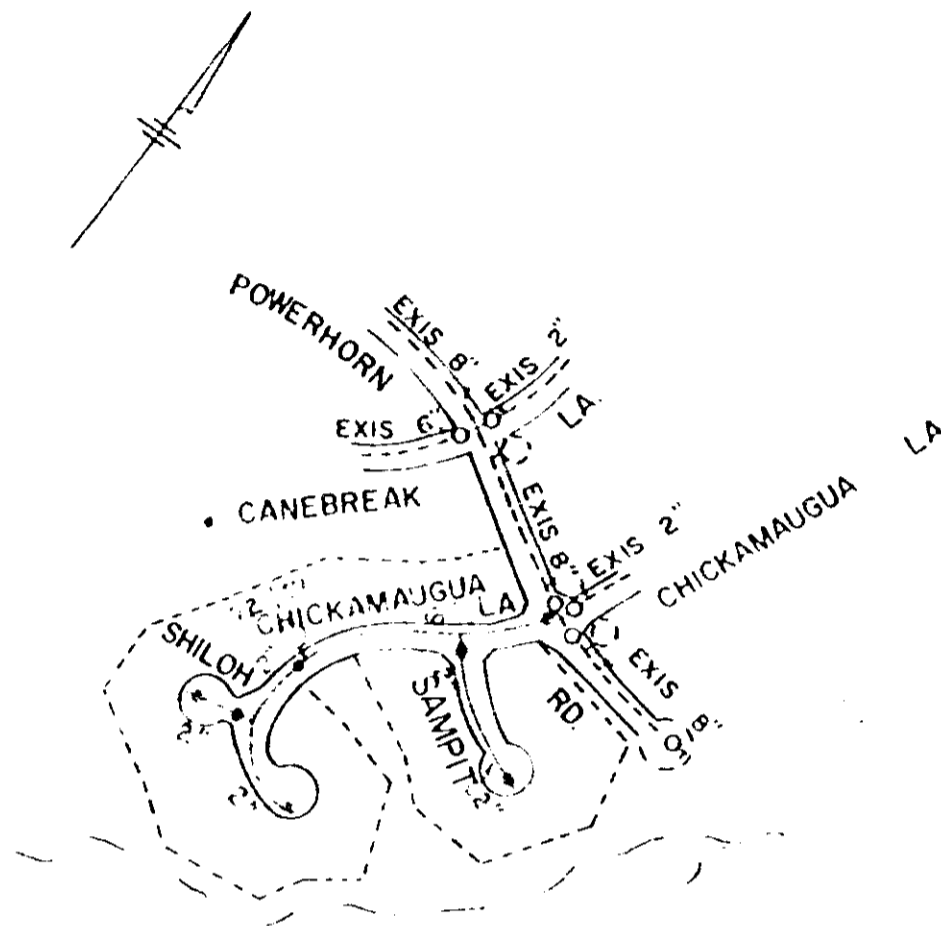

NOTE: ALL VALS & FIRE HYDTS OPEN LI.

POWDERHORN, SEC. II

SEPT. 1975 SCALE 1" = 400'

Material List.

6" C. I. Pipe	-	52.1'
2" Galv. Pipe	-	24.0'
6" Valves	-	2
2" Valves	-	5
Fire Hydrant	-	1

Approved Service Corporation of S. C.  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 October 19, 1977

Pt. of B.L.P. BOOK 323-1-1.3

RECORDED NOV 1 1977 At 2:58 P.M.

13672

4328 RV-2

3  
7  
6