


0250

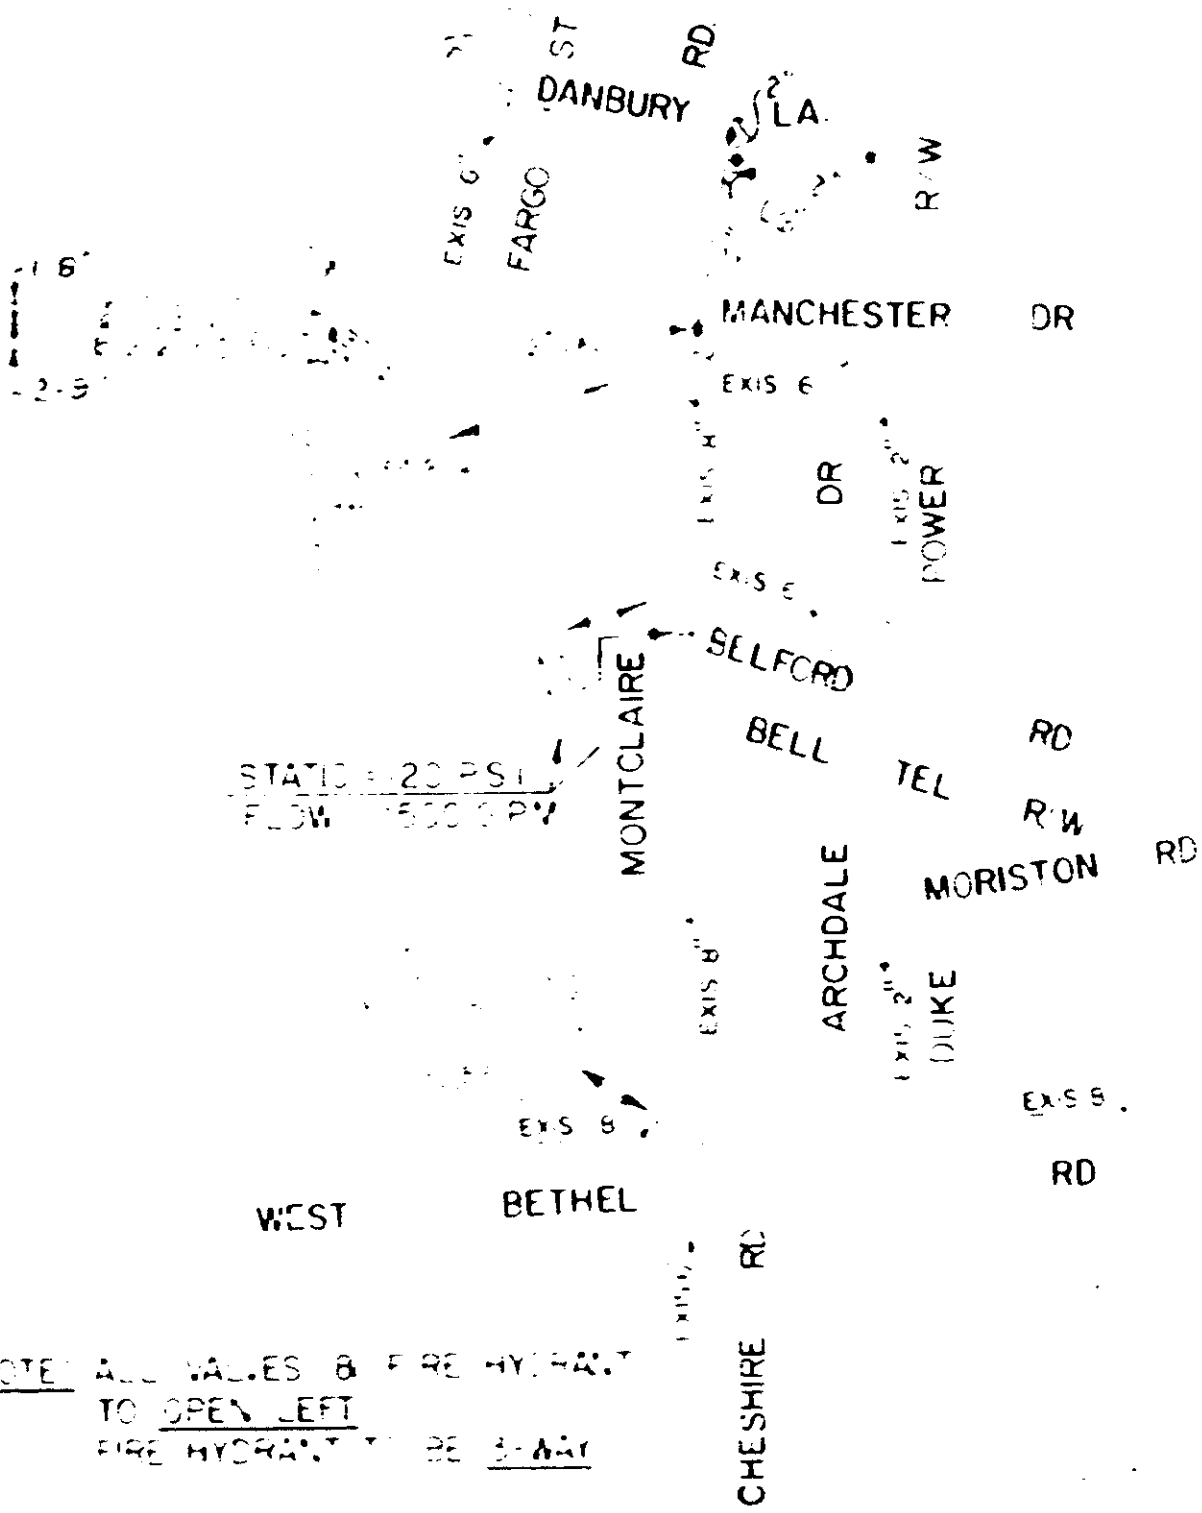

STATIC = 20 PSI
FLOW = 500 GPM

NOTE: ALL VALVES & FIRE HYDRANT
TO OPEN LEFT
FIRE HYDRANT TO BE 3-WAY

MONTCLAIRE SEC-5
AUG, 1977 SCALE 1" = 400'

MATERIAL LIST

Recorded July 17, 1978 at 9:49 A/M

1513

4328 RV.2