


0789

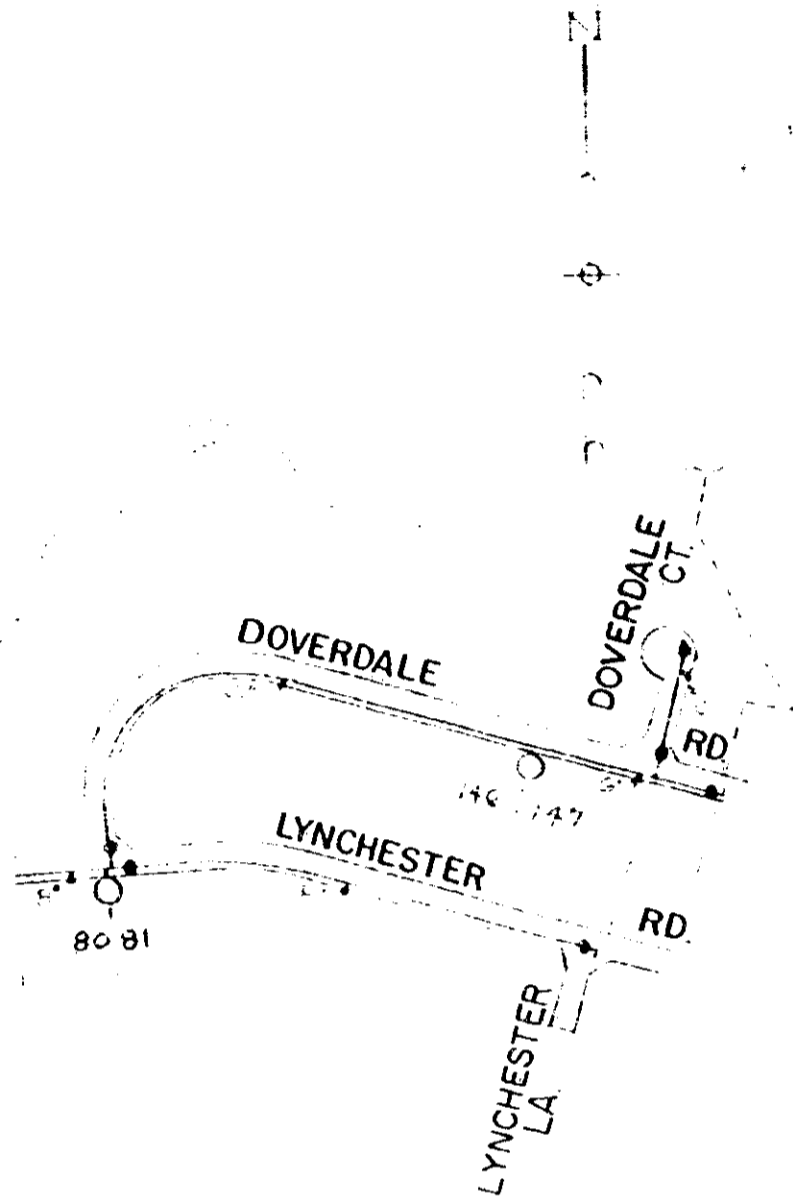

NOTE: ALL 6" & 8" VALS. OPEN RT.
ALL 2" VALS. OPEN LT.
ALL F. HYDS. TO BE 3-WAY & OPEN RT.

Material List:

8" D. I. Pipe	-	1030 ⁺
6" D. I. Pipe	-	1480 ⁺
2" Galv. Pipe	-	220 ⁺
8" Valve	-	1
6" Valves	-	3
2" Valves	-	4
Fire Hydrants	-	2

BROOKFIELD EAST, SEC. I

MAY, 1979 SCALE 1"=400'
 The Vista Co., Inc. and Dee A.
 Smith Co., Inc.

to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 October 19, 1979
 (BLK. BOOK 540.4-1-8.5)

RECORDED NOV 16 1979 at 2:23 P.M.

16730

4328 RV-2