


0497

BOOK 1127 PAGE 497

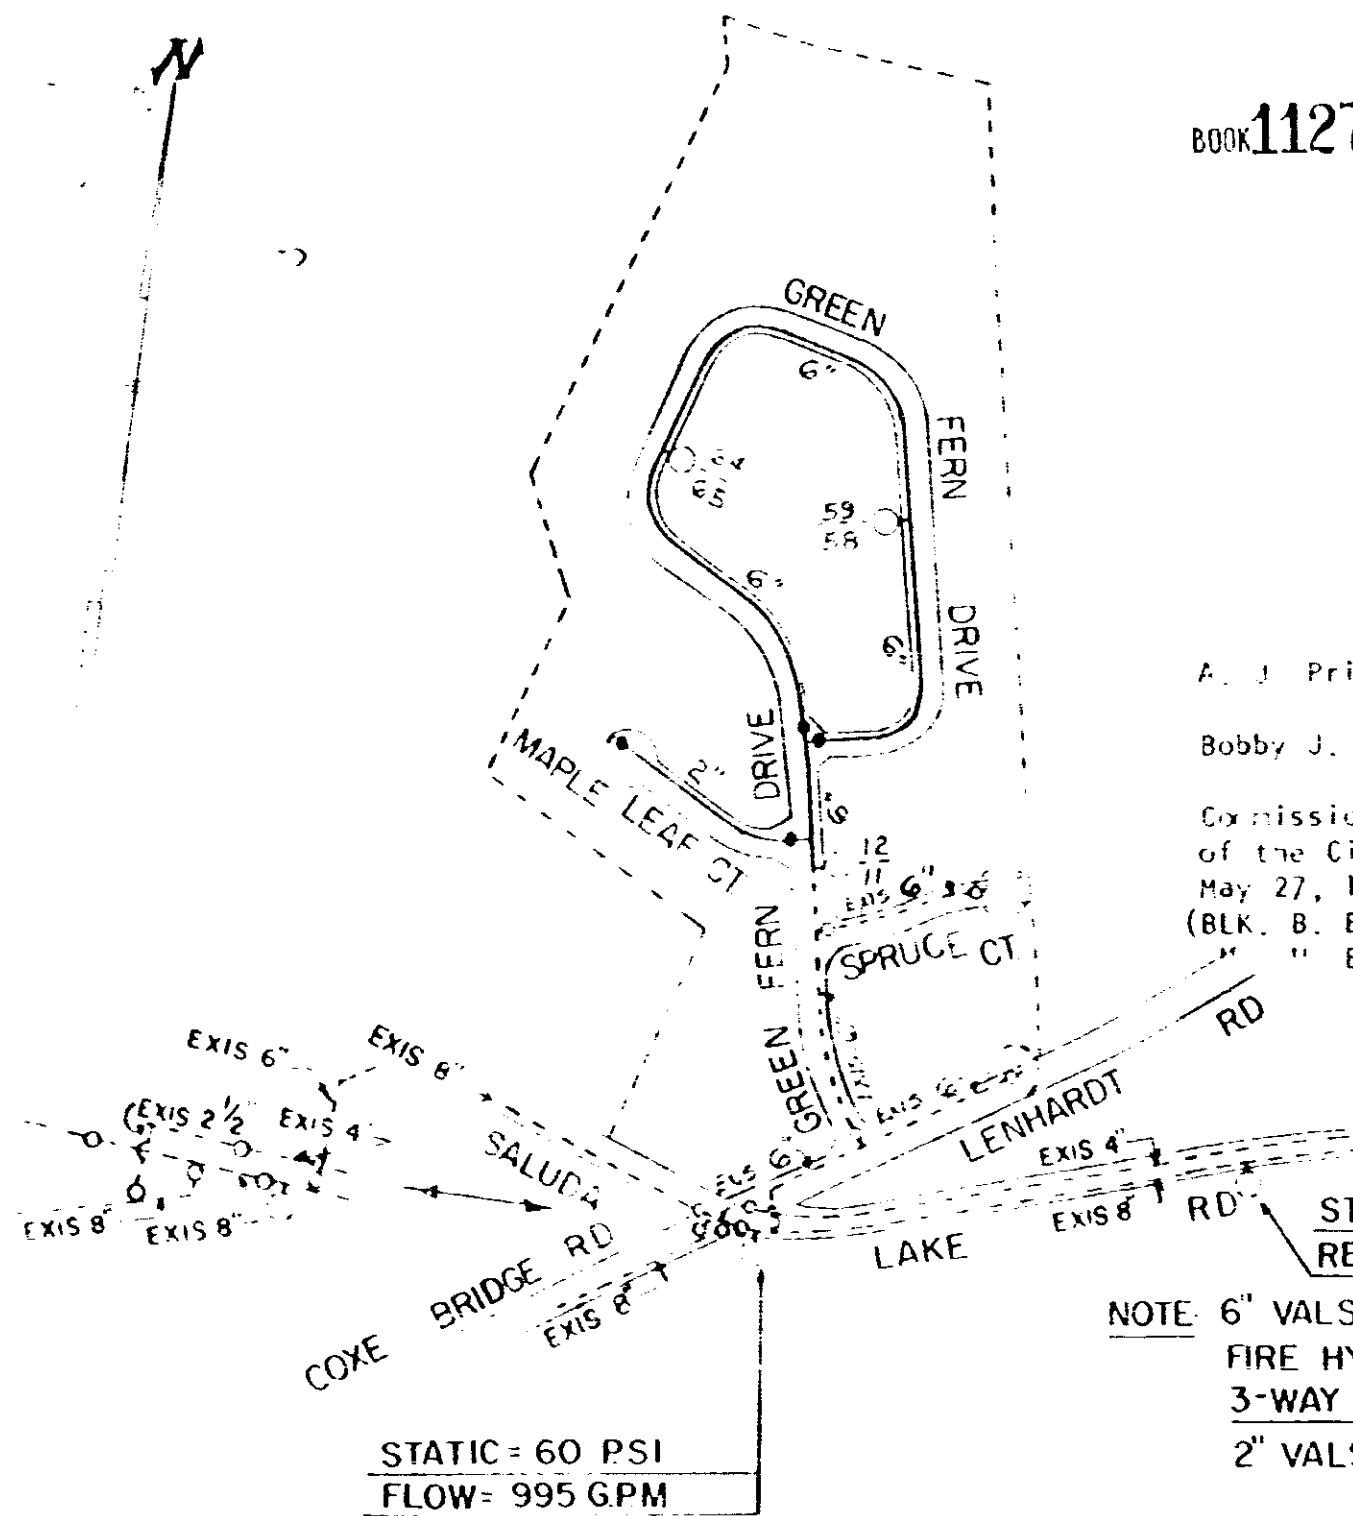

A. J. Prince Builders, Inc.  
 &  
 Bobby J. Jones Builders, Inc.  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 May 27, 1980  
 (BLK. B. B. 1-1-8.2 & 9  
 " " 84.5-1-22.1)

STATIC = 60 PSI  
 FLOW = 995 GPM

STATIC = 60 PSI.  
 RES. = 45 PSI.

NOTE: 6" VALS. OPEN RIGHT  
 FIRE HYDRANTS TO BE  
 3-WAY & OPEN RIGHT  
 2" VALS. OPEN LEFT

MATERIAL LIST:

6" D. I. Pipe	-	2,330'
2" Galv. Pipe	-	410'
6" Valves	-	4
2" Valves	-	2
Fire Hydrants	-	2

WHITE OAK HILLS, SEC. 2

JUNE, 1979 SCALE - 1" = 400'  
 REVISED JULY, 1979

RECORDED JUN 16 1980 at 11:51 A.M.

35783

4328 RV-2