


0.3.3.4

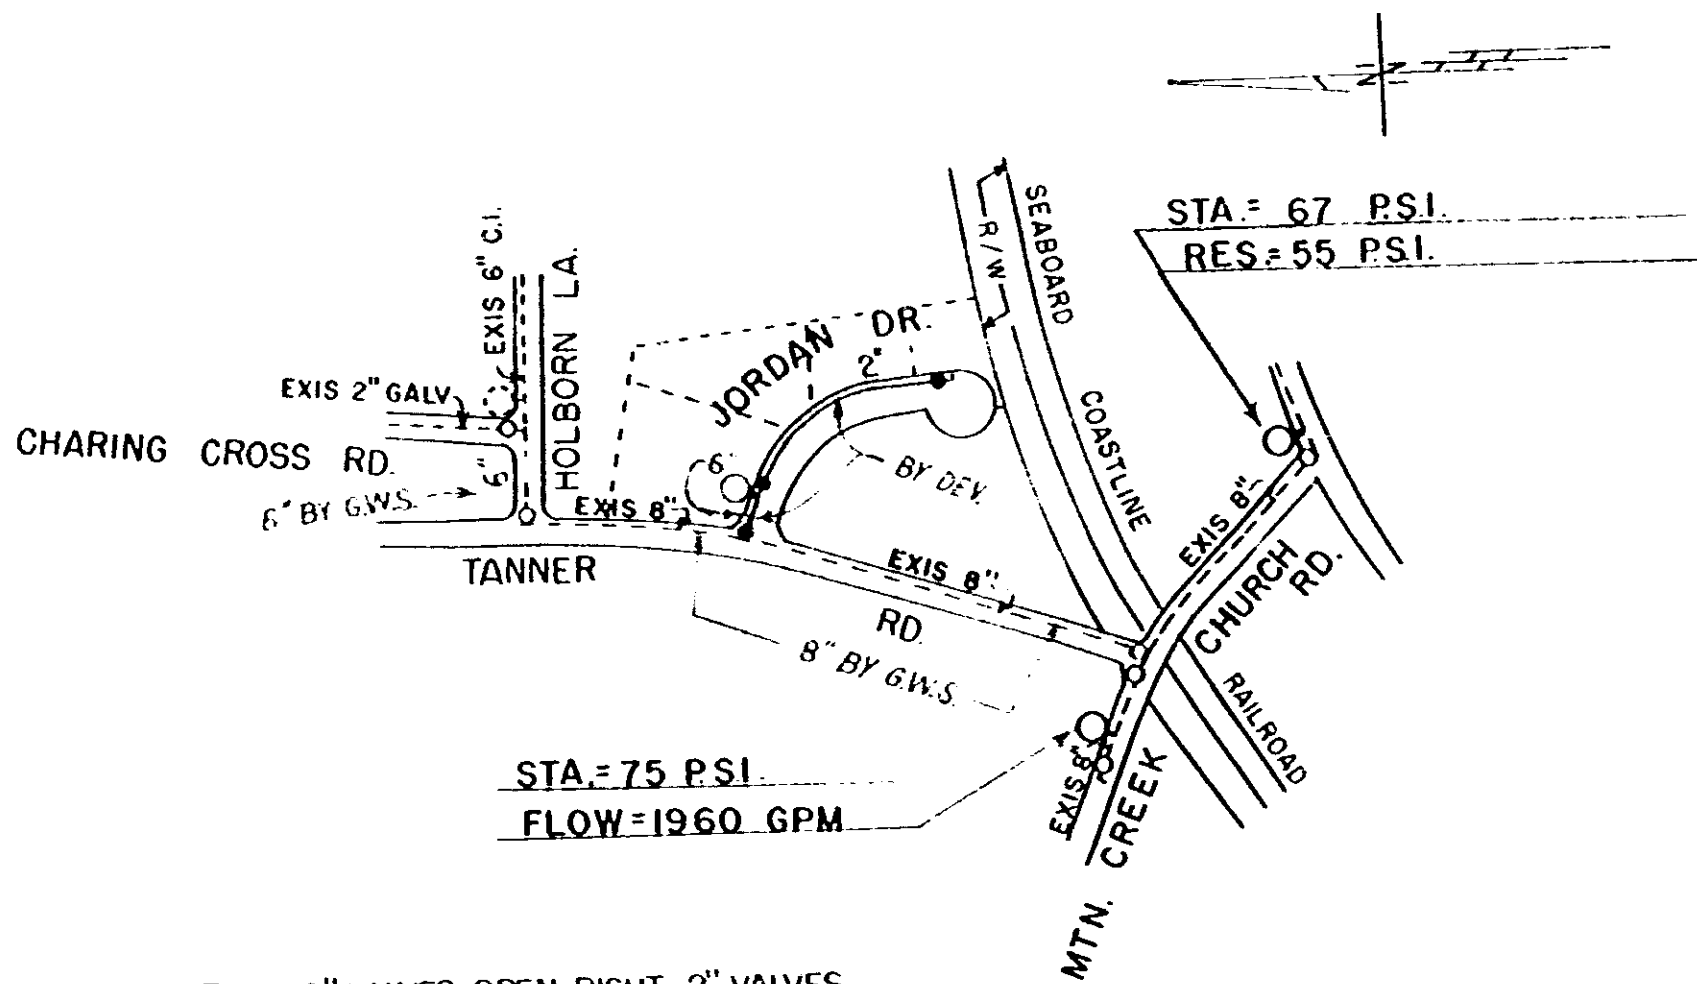

NOTE: 6" VALVES OPEN RIGHT, 2" VALVES OPEN LEFT, FIRE HYDRANT TO BE 3-WAY & OPEN RIGHT

MATERIAL LIST:

6" D. I. Pipe	-	100'±
2" Galv. Pipe	-	410'±
6" Valves	-	2
2" Valves	-	2
Fire Hydrant	-	1

Mr. Lambert W. Jordan  
to  
Commissioners of Public Works  
of the City of Greenville, S. C.  
July 10, 1980  
(Block Book T29.4-1- 41)

JORDAN PARK  
DEC, 1979 SCALE: 1"=40'

RECORDED JUL 16 1980 at 3:49 P.M.

1387

4328 RV-2