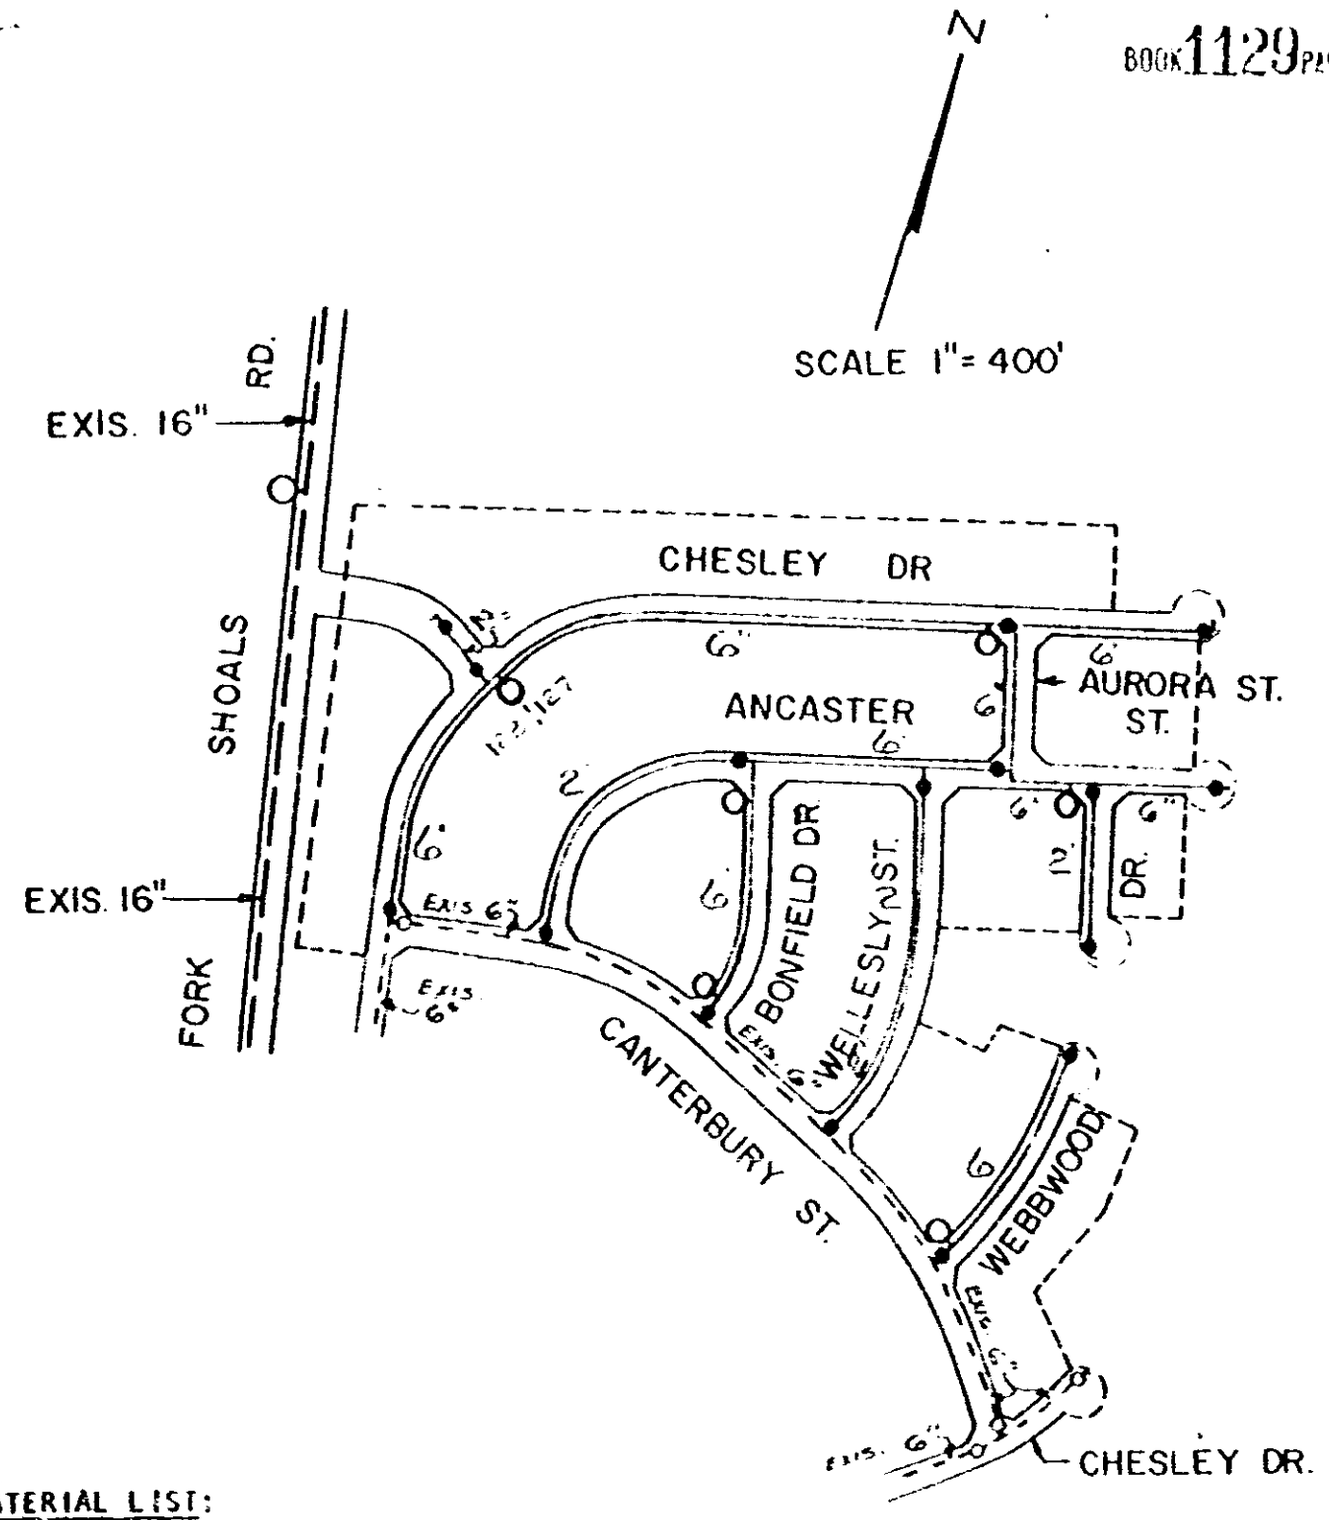

MATERIAL LIST:

6" C. I. Pipe	-	4,125'±
2" Galv. Pipe	-	1,850'±
6" Valves	-	11
2" Valves	-	11
Fire Hydrants	-	6

THE VILLAGE, SEC. II

NOVEMBER, 1972
REVISED , 1980

Fortis Enterprises, Inc.
to
Commissioners of Public Works
of the City of Greenville, S. C.
July 11, 1980
(Pt. of BLK. BOOK 585.1-1-1.1)

2281

Recorded July 25, 1980 at 12:20 P M