


BOOK 1145 PAGE 284

0284

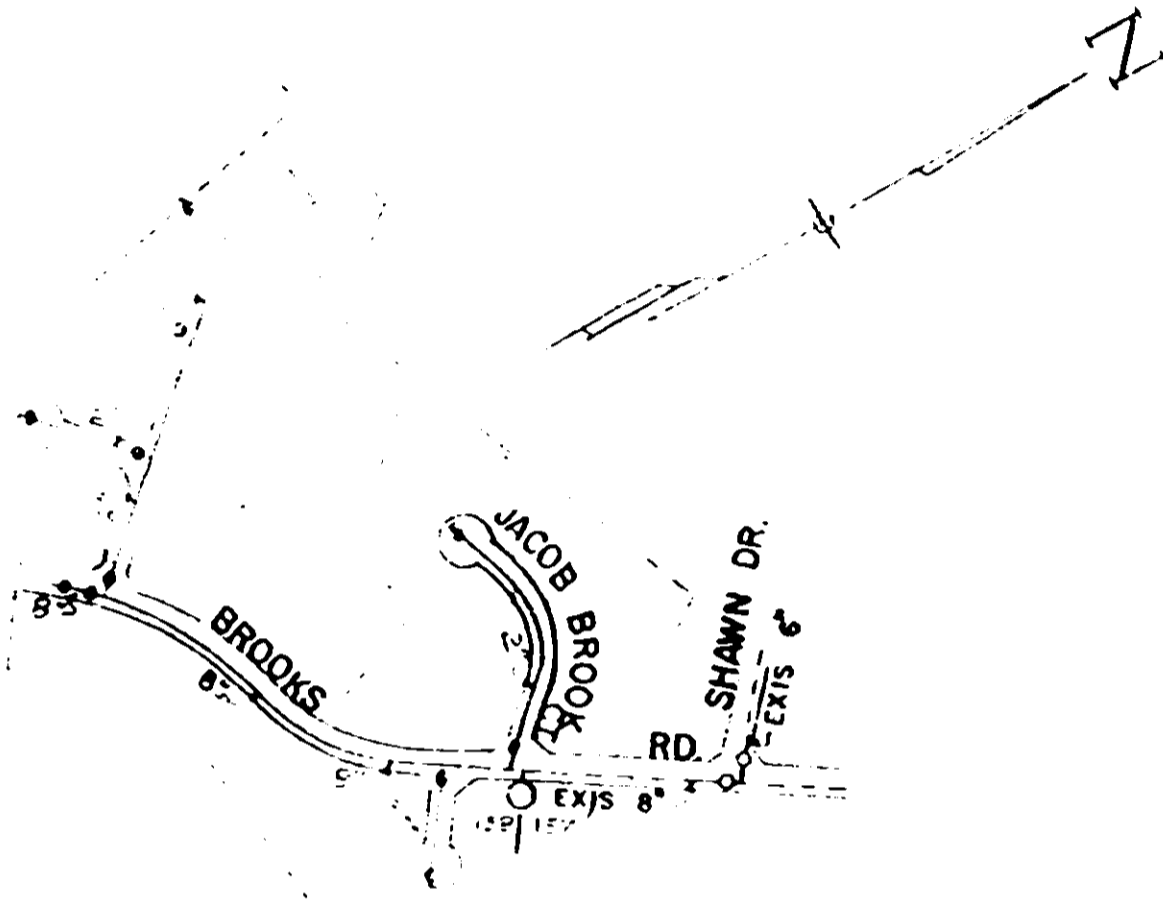

NOTE: 6" & 8" VALS. OPEN RIGHT
2" VALS. OPEN LEFT
FIRE HYDS TO BE 3-WAY & OPEN RIGHT

MATERIAL LIST:

| | | |
|---------------|---|---------|
| 8" D. I. Pipe | - | 900'± |
| 6" C. I. Pipe | - | 850'± |
| 2" Galv. Pipe | - | 1,070'± |
| 8" Valve | - | 1 |
| 6" Valves | - | 3 |
| 2" Valves | - | 2 |
| Fire Hydrants | - | 2 |

BROOKSIDE SEC. 6 PH. 1

MAR 1981 SCALE 1"=400'

OK ✓
 Donald E. Baltz
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 March 23, 1981
 BLK. BOOK M6.1-1-5

RECORDED MAR 30 1981 at 2:83 A.M.

27116

~~27116~~

4325 RV-2