


BOOK 1155 PAGE 965

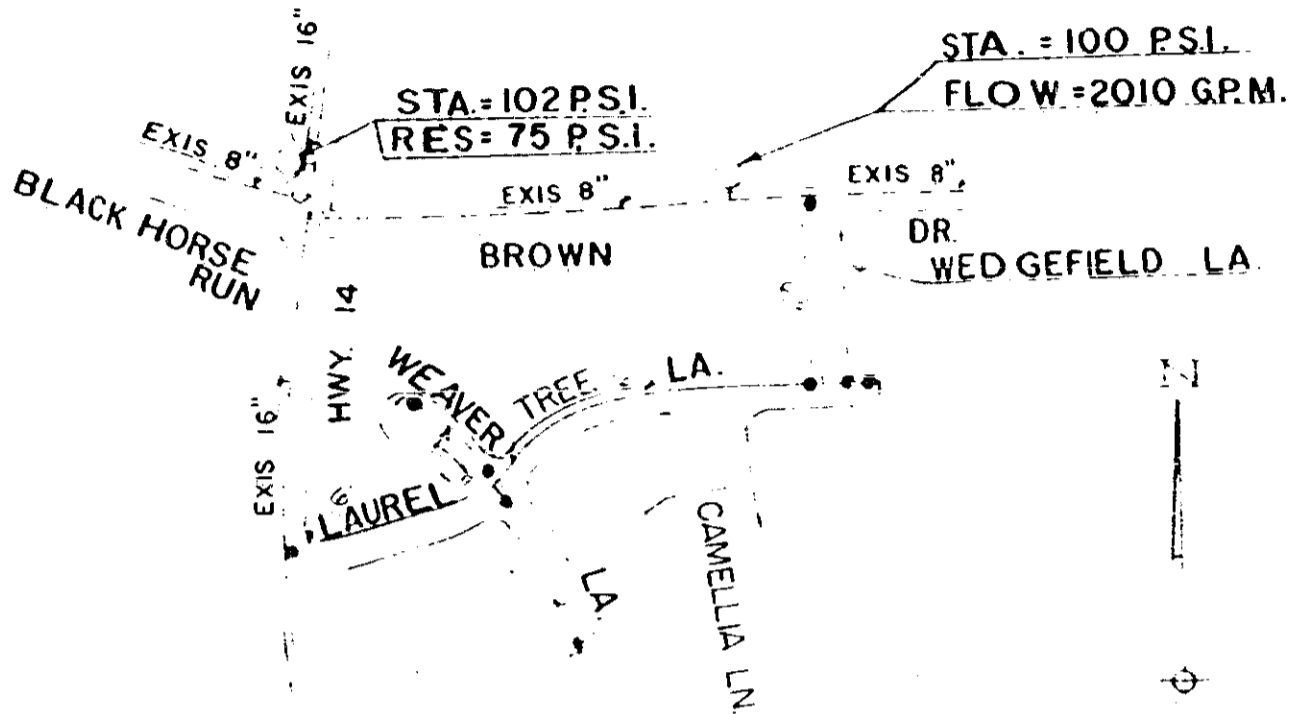

Material List:

6" D. I. Pipe	-	1,955'
2" Galv. Pipe	-	220'
6" Valves	-	6
2" Valves	-	4
Fire Hydrant	-	1

NOTE: 6 VALS OPEN RIGHT  
2 VALS OPEN LEFT  
 FIRE HYD. TO BE 3-WAY & OPEN RIGHT

The Fortis Corporation  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 August 31, 1981  
 Pt. of BLE. Book 539.1-1-15.1

WEDGEFIELD SUBD.  
 MAR. 1981 SCALE 1" = 400'  
 REVISED 3-20-81

RECORDED SEP 29 1981 at 4:35 P.M.

8032

53  
 0.96  
 0.

4328 RV-2