


VOL 1167 PAGE 967

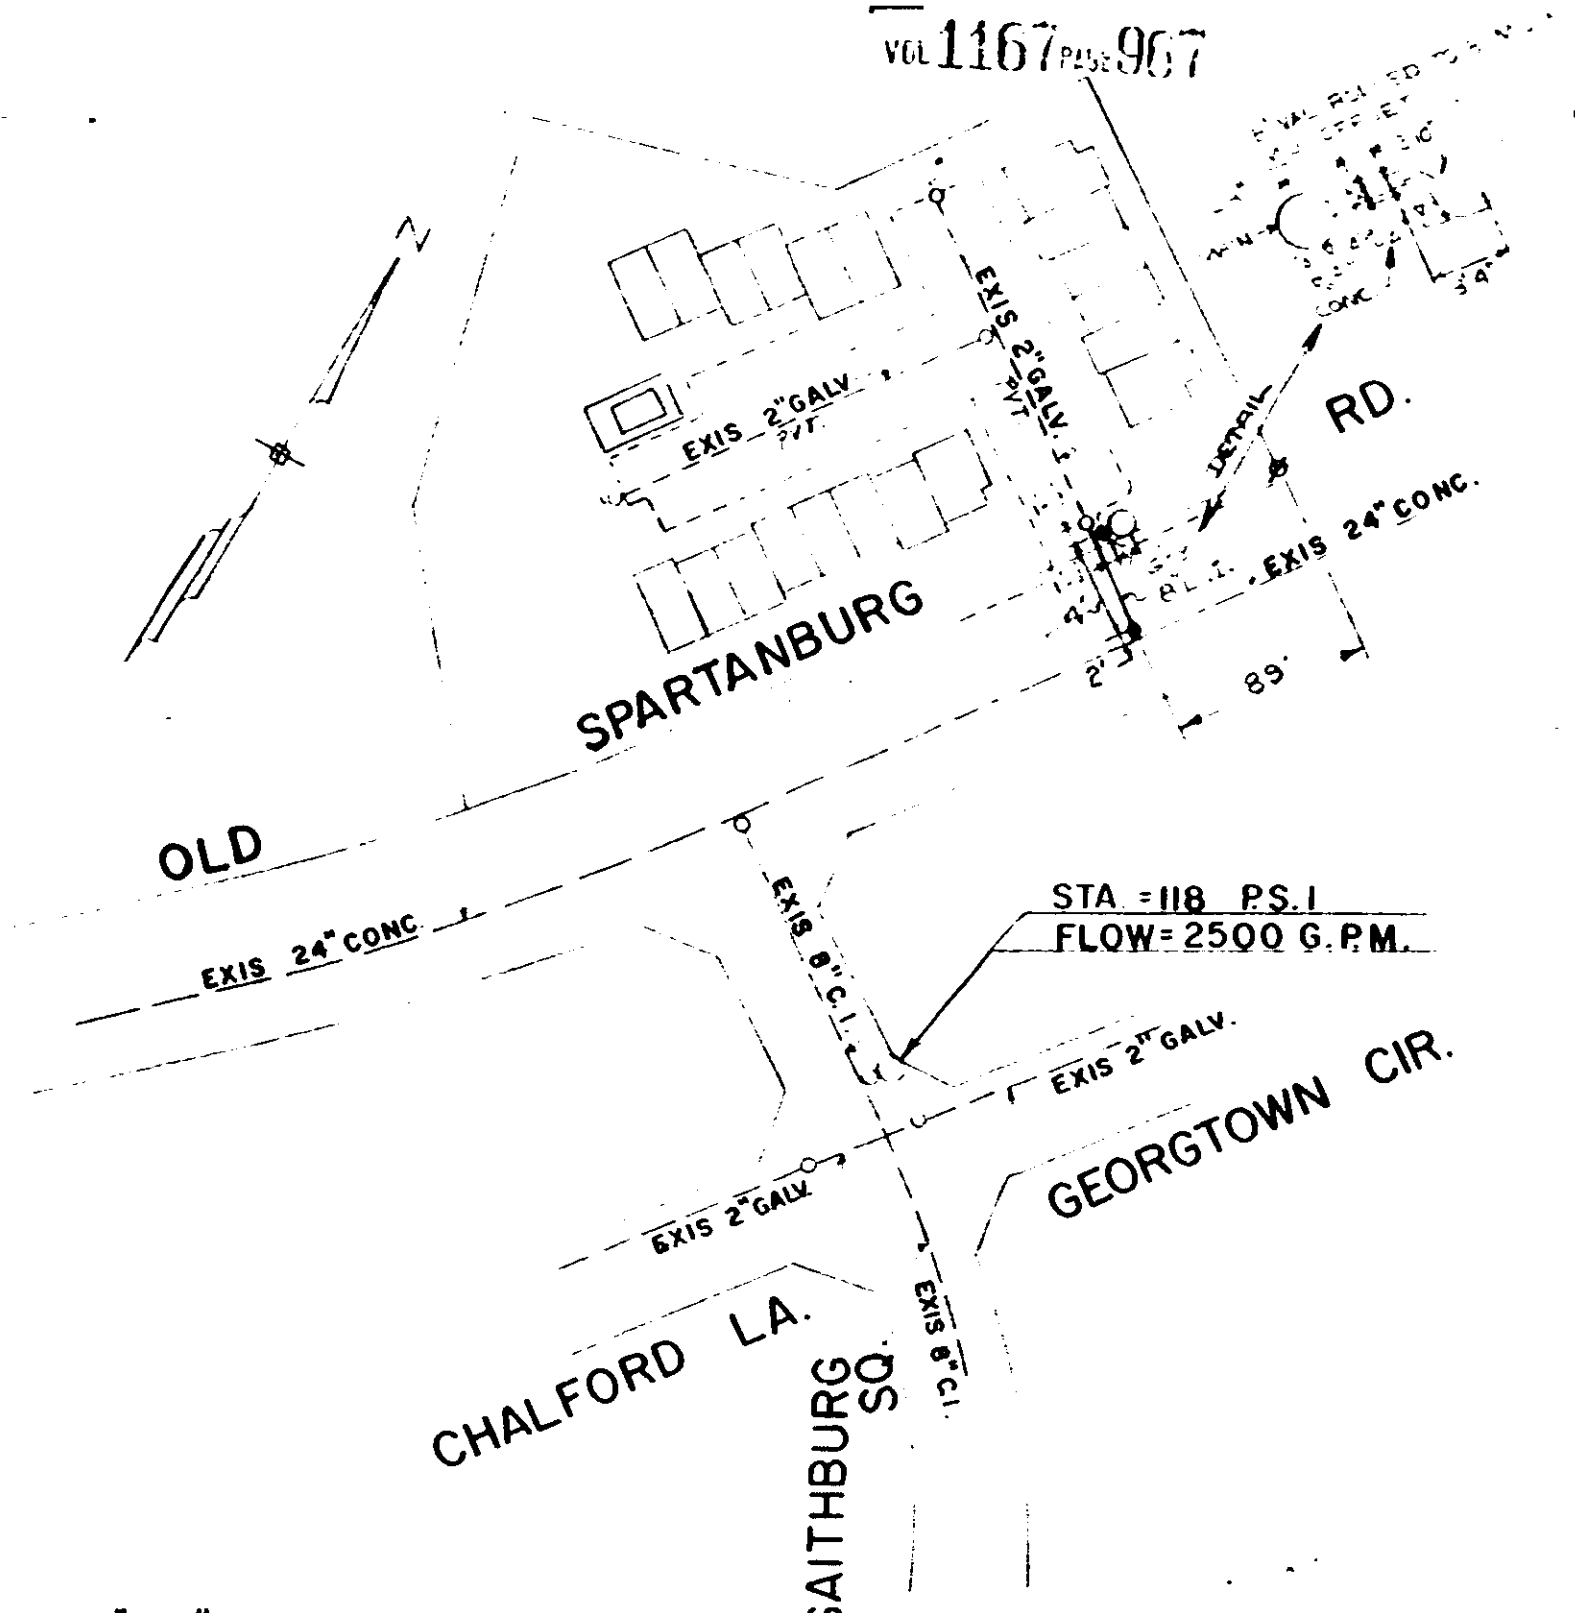

NOTE 6" & 8" VALS. OPEN RIGHT
FIRE HYDS. TO BE 3-WAY & OPEN RIGHT

MATERIAL LIST:

8" D. I. Pipe	-	64'±
6" D. I. Pipe	-	10'±
8" Valve	-	1
6" Valve	-	1
Fire Hydrant	-	1

JAVA EAST

✓ F. HAROLD Gillespie DEC., 1981 SCALE 1"=100'
~~H. L. Butler & Associates~~
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 December 23, 1981
 (BLK. BOOK 538.4-1-3)

RECORDED JUN 3 1982 at 10:24 A.M.

27015

967

4328 RV.2