


0572

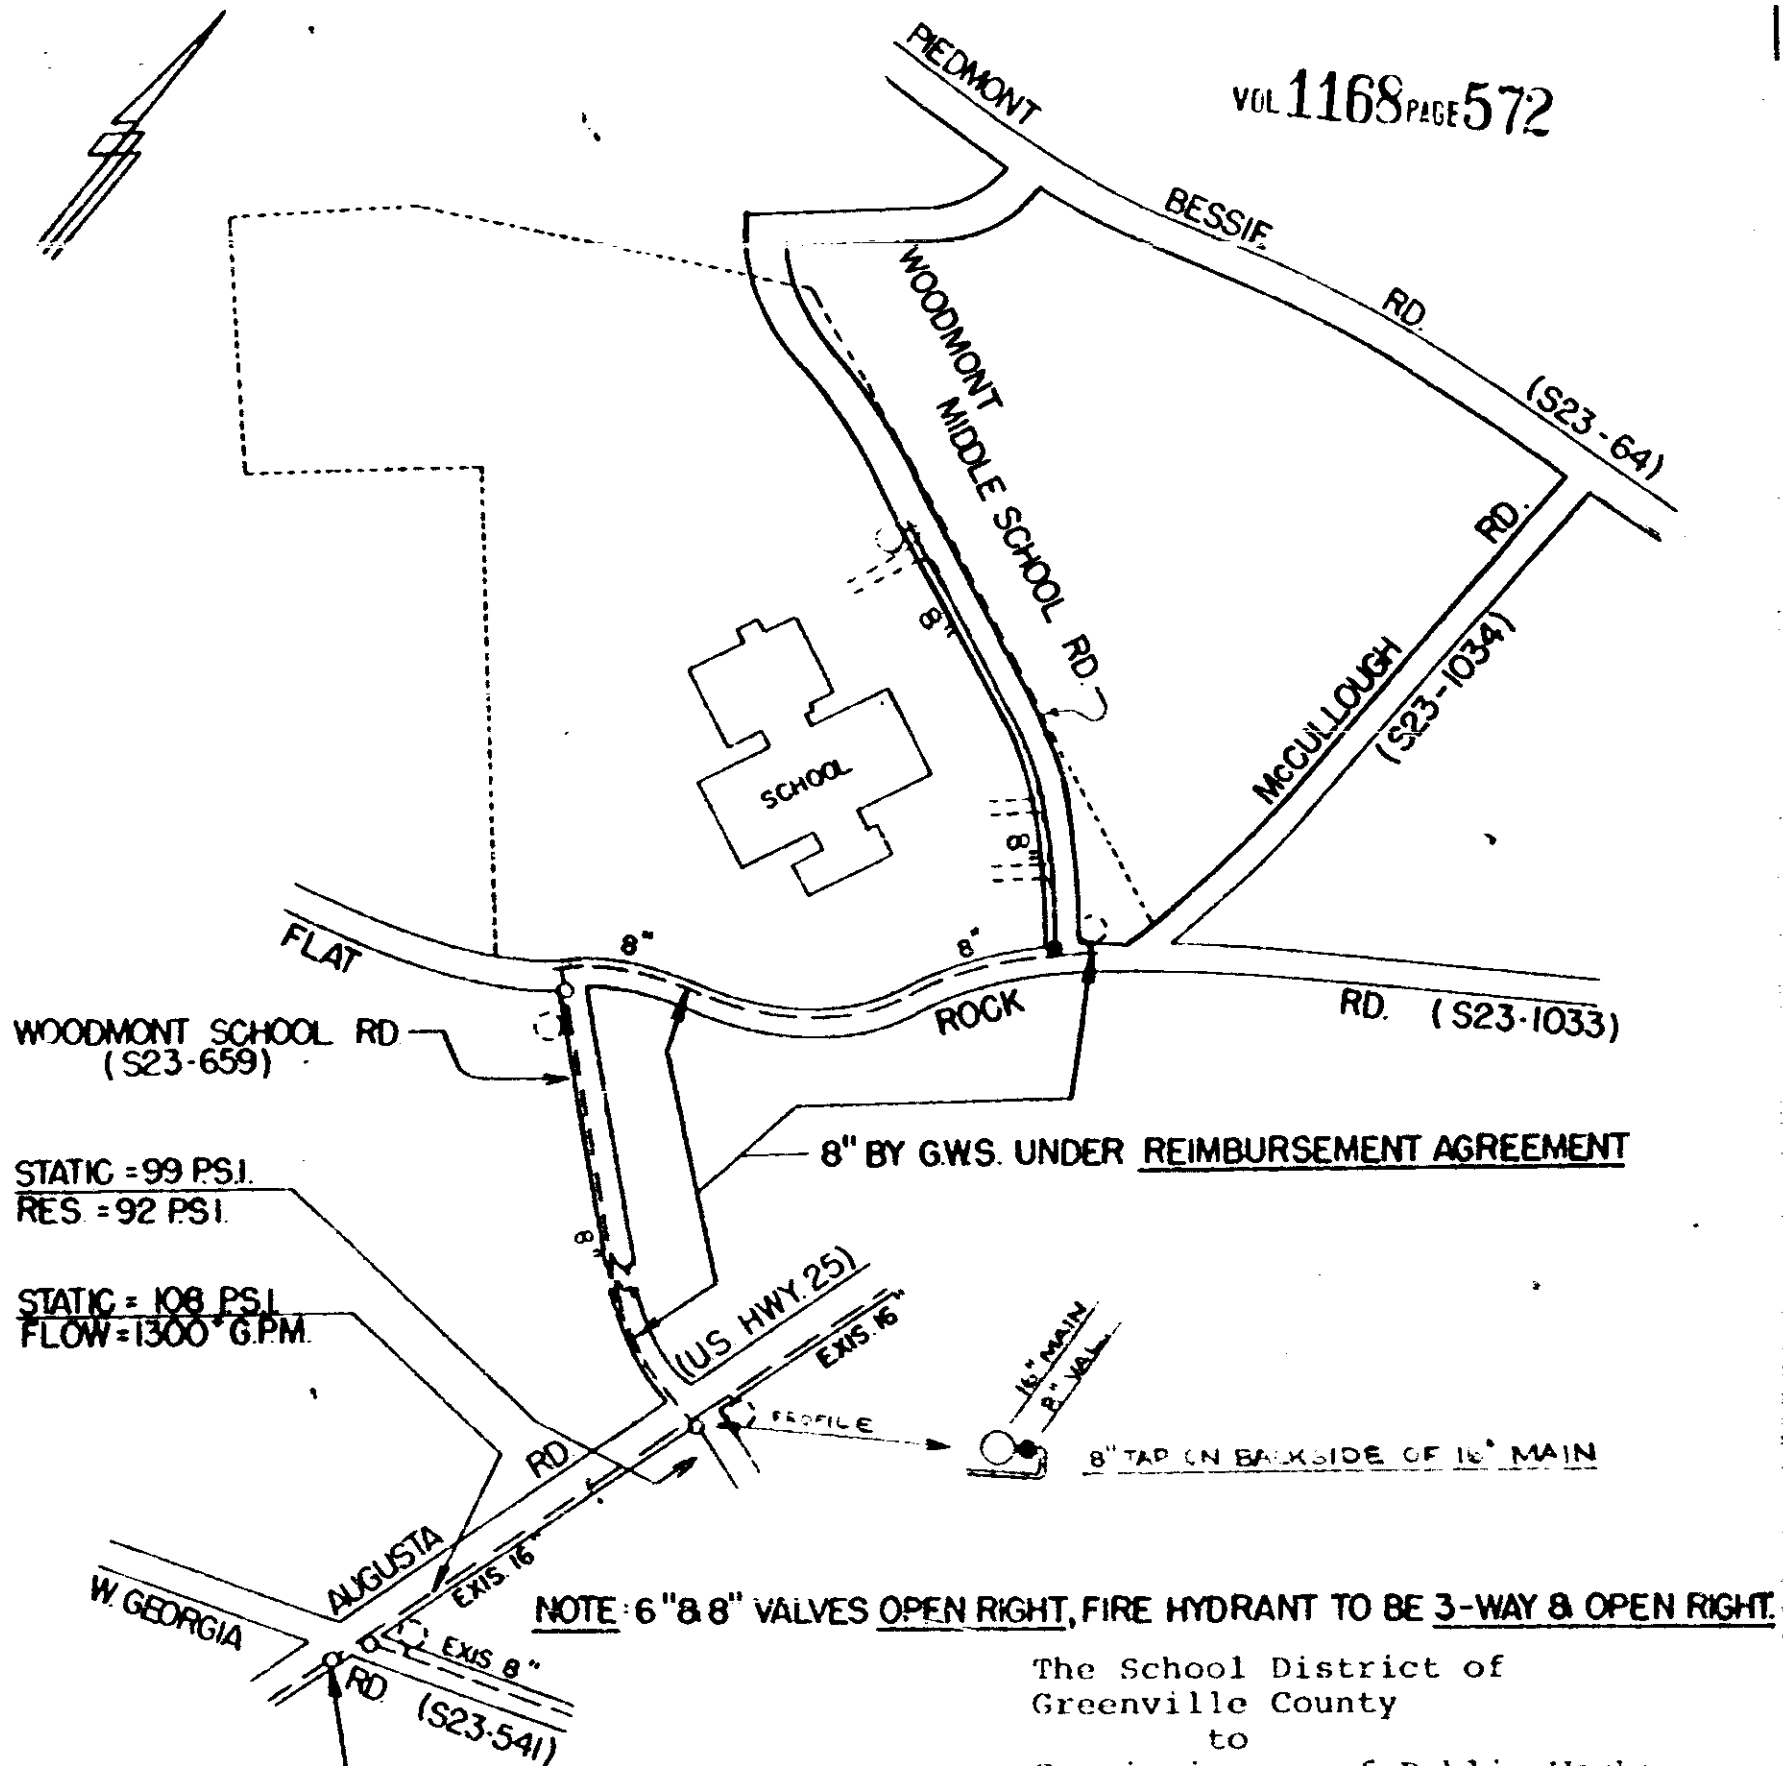

STATIC = 99 PSI.
RES = 92 PSI.

STATIC = 108 PSI.
FLOW = 1300 G.P.M.

8" BY G.W.S. UNDER REIMBURSEMENT AGREEMENT

8" TAP ON BACKSIDE OF 16" MAIN

NOTE: 6" & 8" VALVES OPEN RIGHT, FIRE HYDRANT TO BE 3-WAY & OPEN RIGHT.

The School District of
Greenville County
to
Commissioners of Public Works
of the City of Greenville, S. C.
May 31, 1982
(BLK. Book 602.1-1-40.1)

MATERIAL LIST:

8" D. I. Pipe	-	848'±
6" D. I. Pipe	-	14'±
8" Valve	-	1
6" Valve	-	1
Fire Hydrant	-	1

WOODMONT MIDDLE SCHOOL

MAY, 1981

SCALE 1" = 400'

RECORDED JUN 14 1982 at 3:30 P.M.

27974

4328 RV-2