VOL 1172 PAGE 203

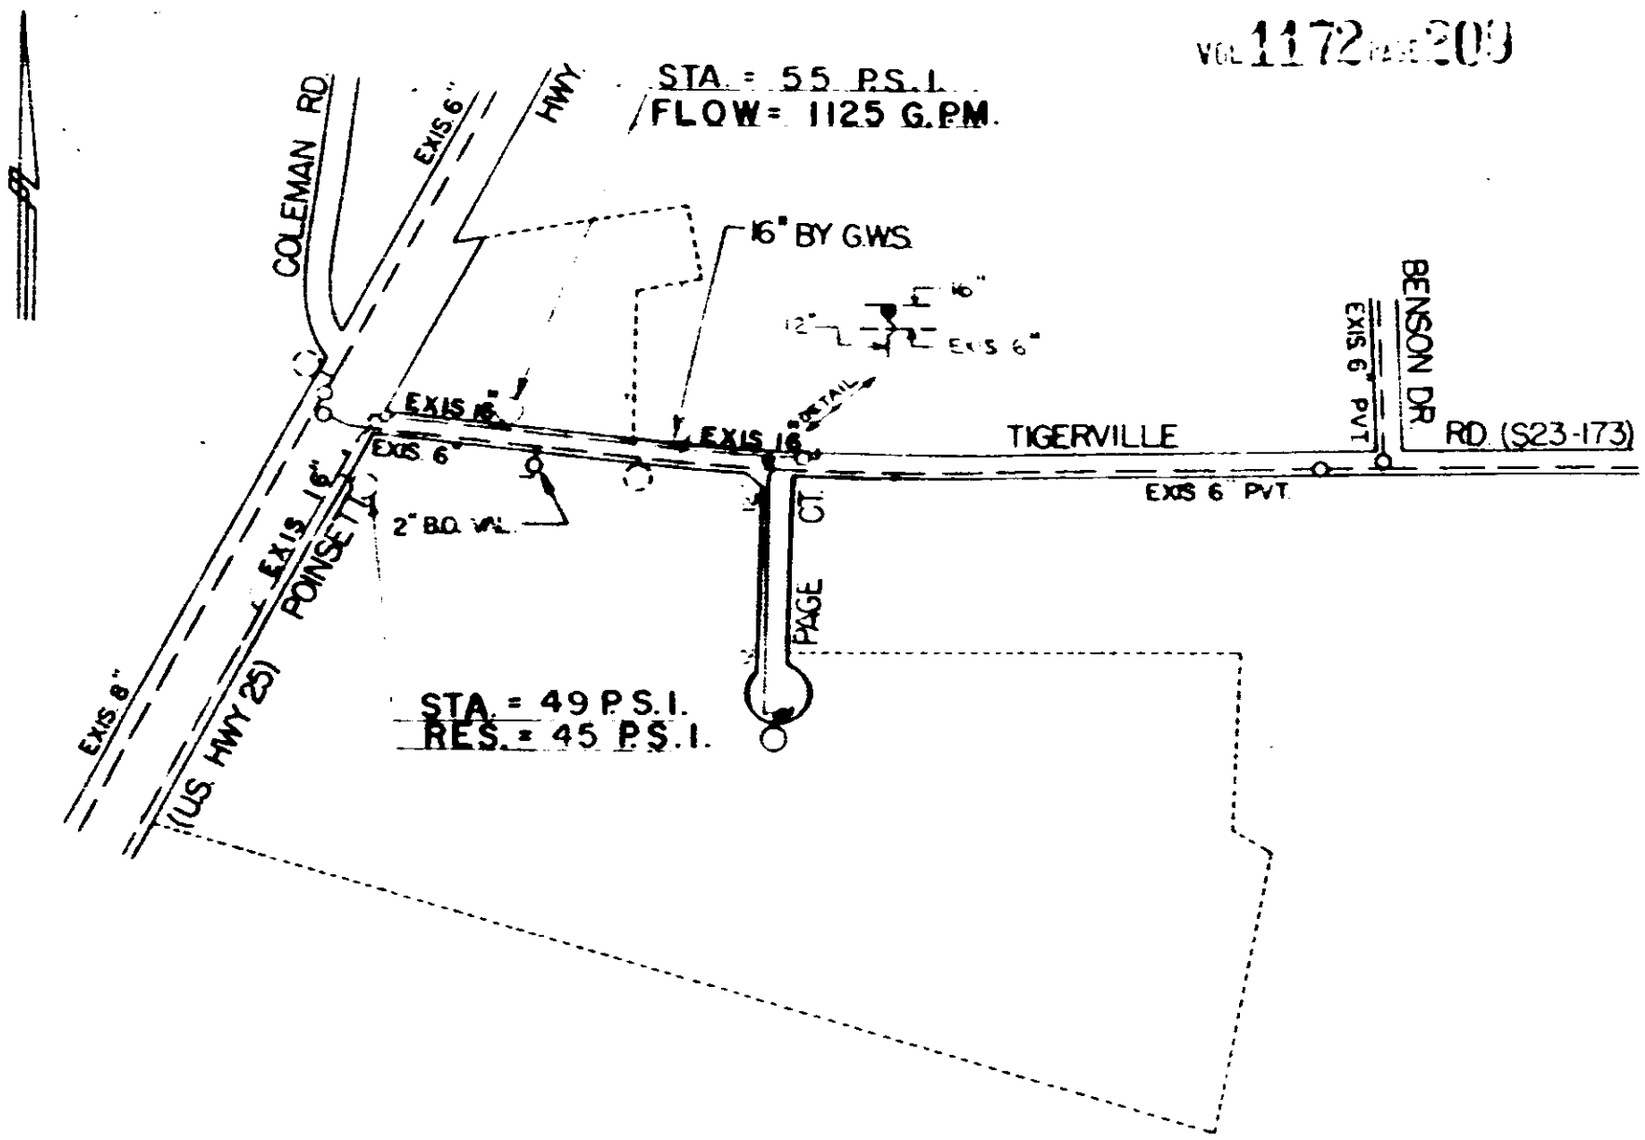

NOTE 12" & 6" VALS OPEN RIGHT, 2" VAL OPENS LEFT, FIRE HYD TO BE 3-WAY & OPEN RIGHT.

Material List:

12" D. I. Pipe	-	582'±
12" Valve	-	1
6" Valve	-	1
2" Valve	-	1
Fire Hydrant	-	1
Valve Boxes	-	3

Krieger Development Co. a partnership
to
Commissioners of Public Works
of the City of Greenville, S. C.
July 26, 1982
Pt. BB 503.2-1-29

KRIEGER PARK

JUNE, 1981 SCALE 1" = 400'

RECORDED AUG 16 1982 at 9:29 A.M. 37771

4328 RV.2