


0613

VOL 1191 PAGE 613

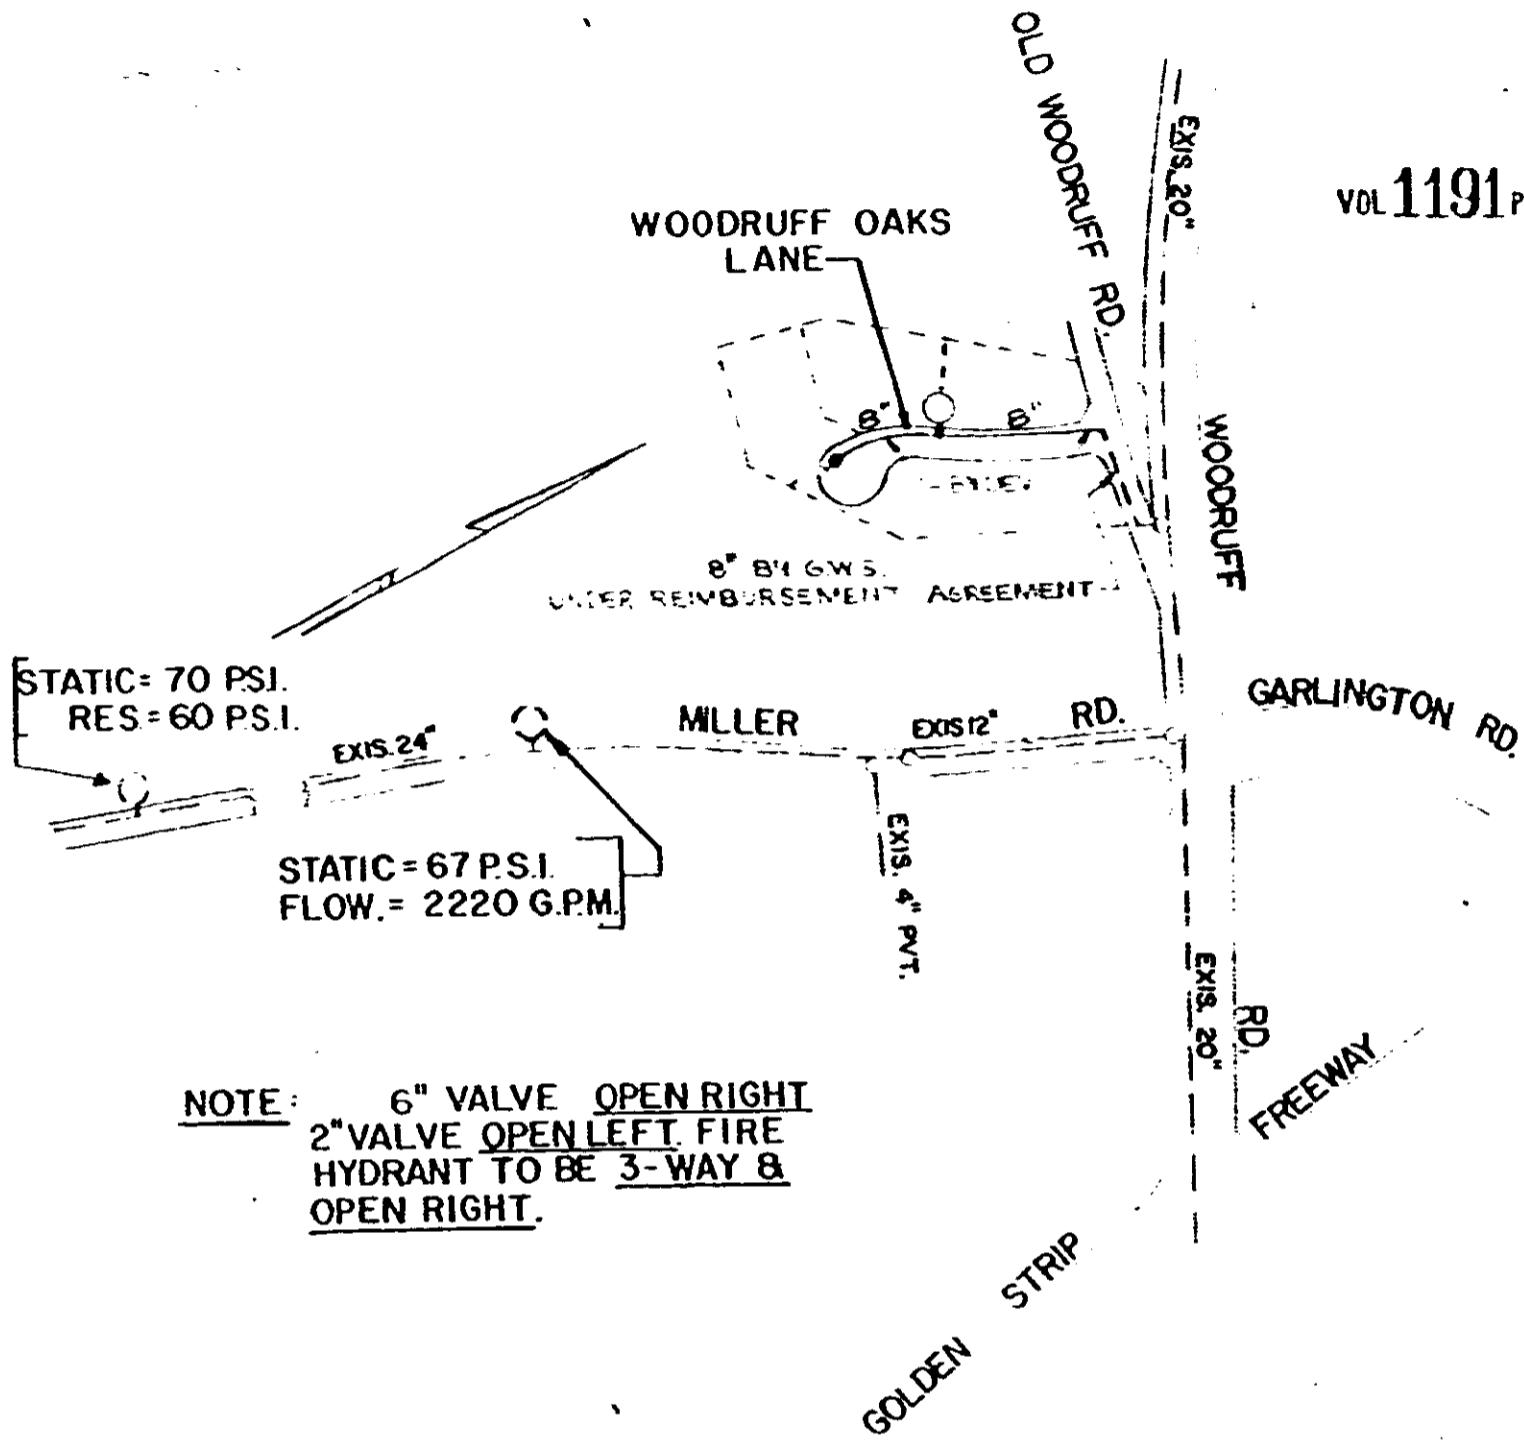

NOTE: 6" VALVE OPEN RIGHT
 2" VALVE OPEN LEFT. FIRE
 HYDRANT TO BE 3-WAY &
 OPEN RIGHT.

MATERIAL LIST:

8" D. I. Pipe	-	522' ±
6" Valve	-	1
2" Valve	-	1
Fire Hydrant	-	1
Valve Boxes	-	2

WOODRUFF OAKS PARK
 MARCH, 1983 SCALE 1" = 400'

✓ Venture III Associates
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 June 10, 1983
 BLK. BOOK 547.1-1-12.4

RECORDED JUL 1 1983 at 3:09 P.M.

161

4328-RV-2