


VOL 1195 PAGE 427

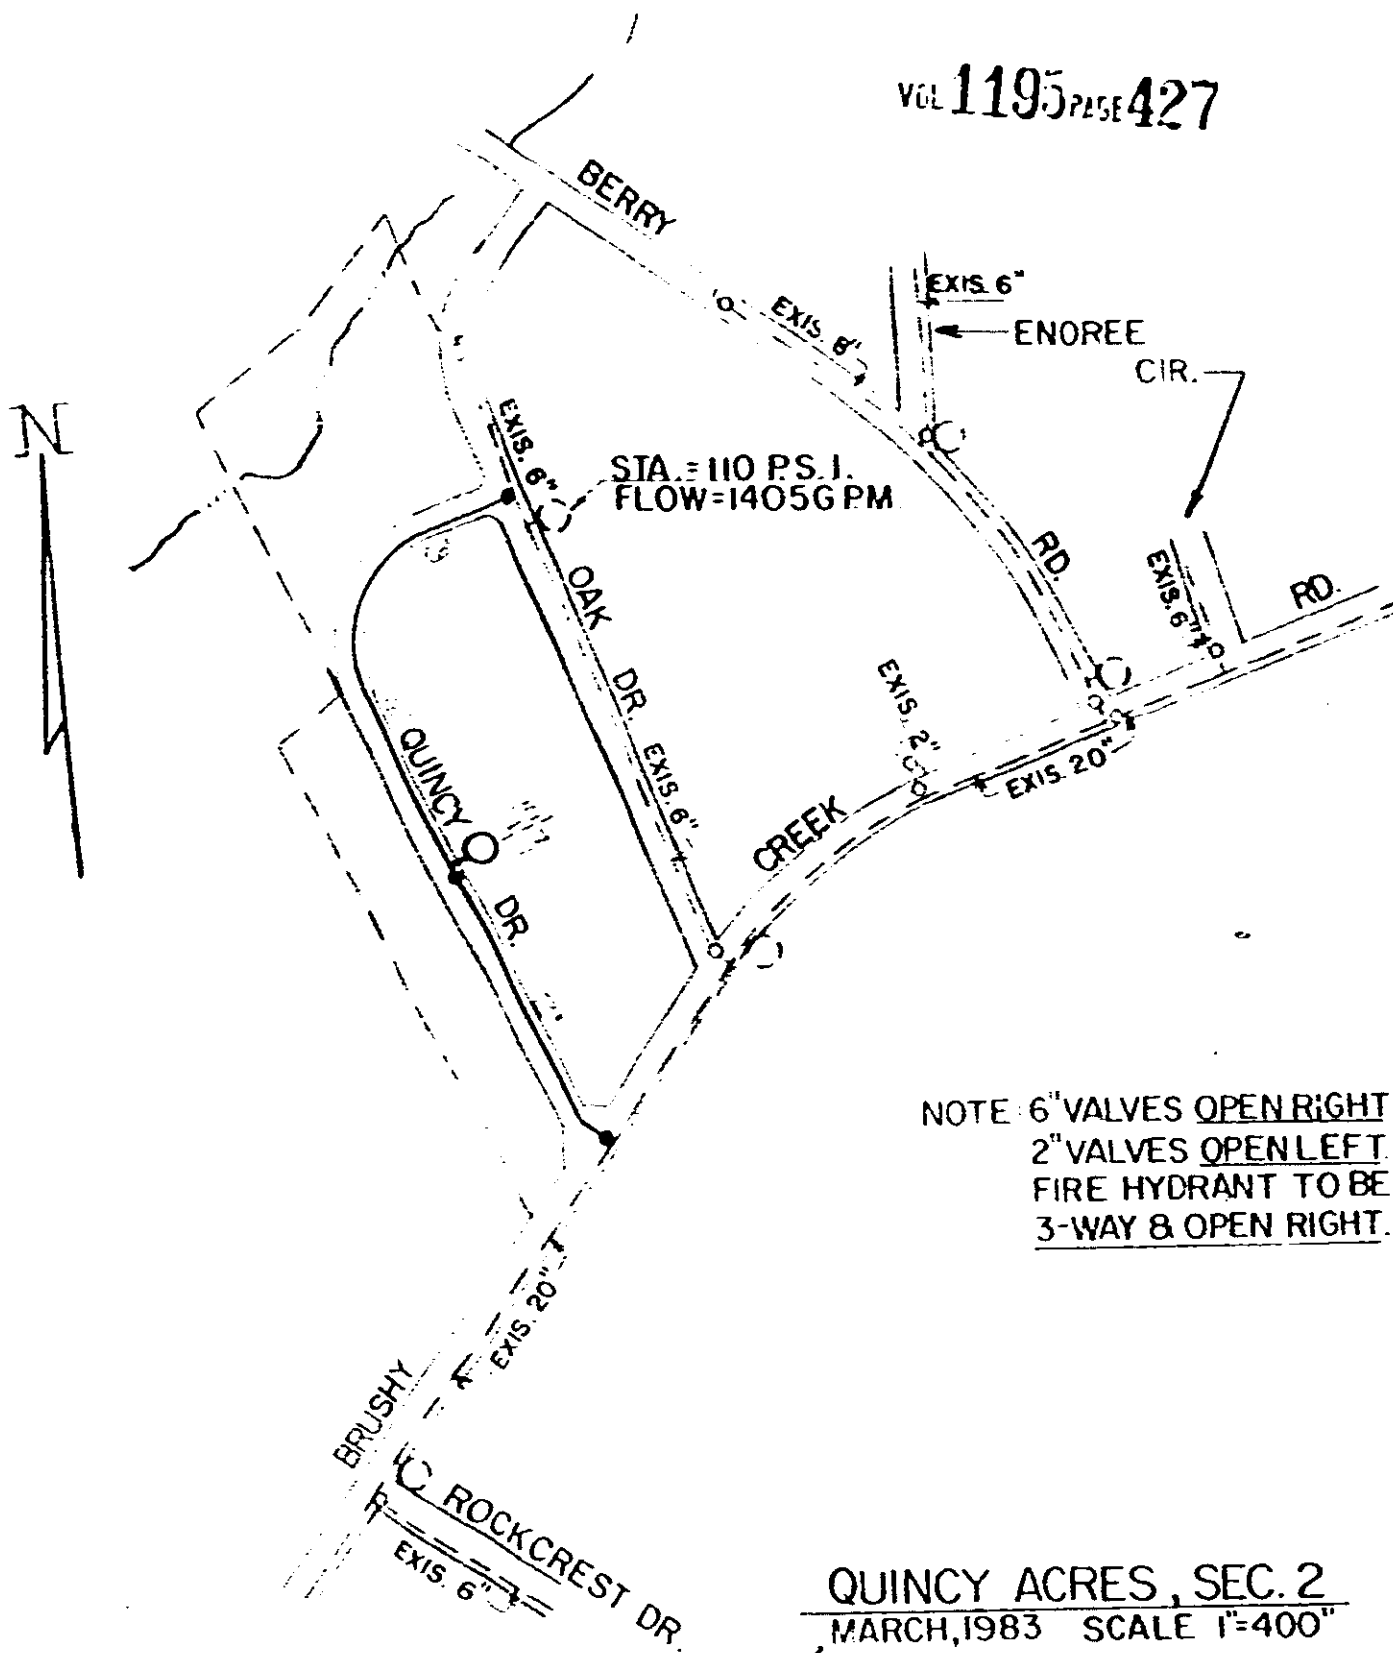

NOTE: 6" VALVES OPEN RIGHT
 2" VALVES OPEN LEFT
 FIRE HYDRANT TO BE
 3-WAY & OPEN RIGHT.

QUINCY ACRES, SEC. 2
 MARCH, 1983 SCALE 1"=400'

✓ Fr. Lollie G. Gibson
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 August 12, 1983
 Block Book 538.5-1-5.1

MATERIAL LIST:

6" D. I. Pipe	-	940'
2" Galv. Pipe	-	590'
6" Valves	-	2
2" Valves	-	2
Fire Hydrant	-	1
Valve Boxes	-	4

Recorded August 31, 1983 at 10:18A.M.

7223

0.427

4378-RV-21