


070

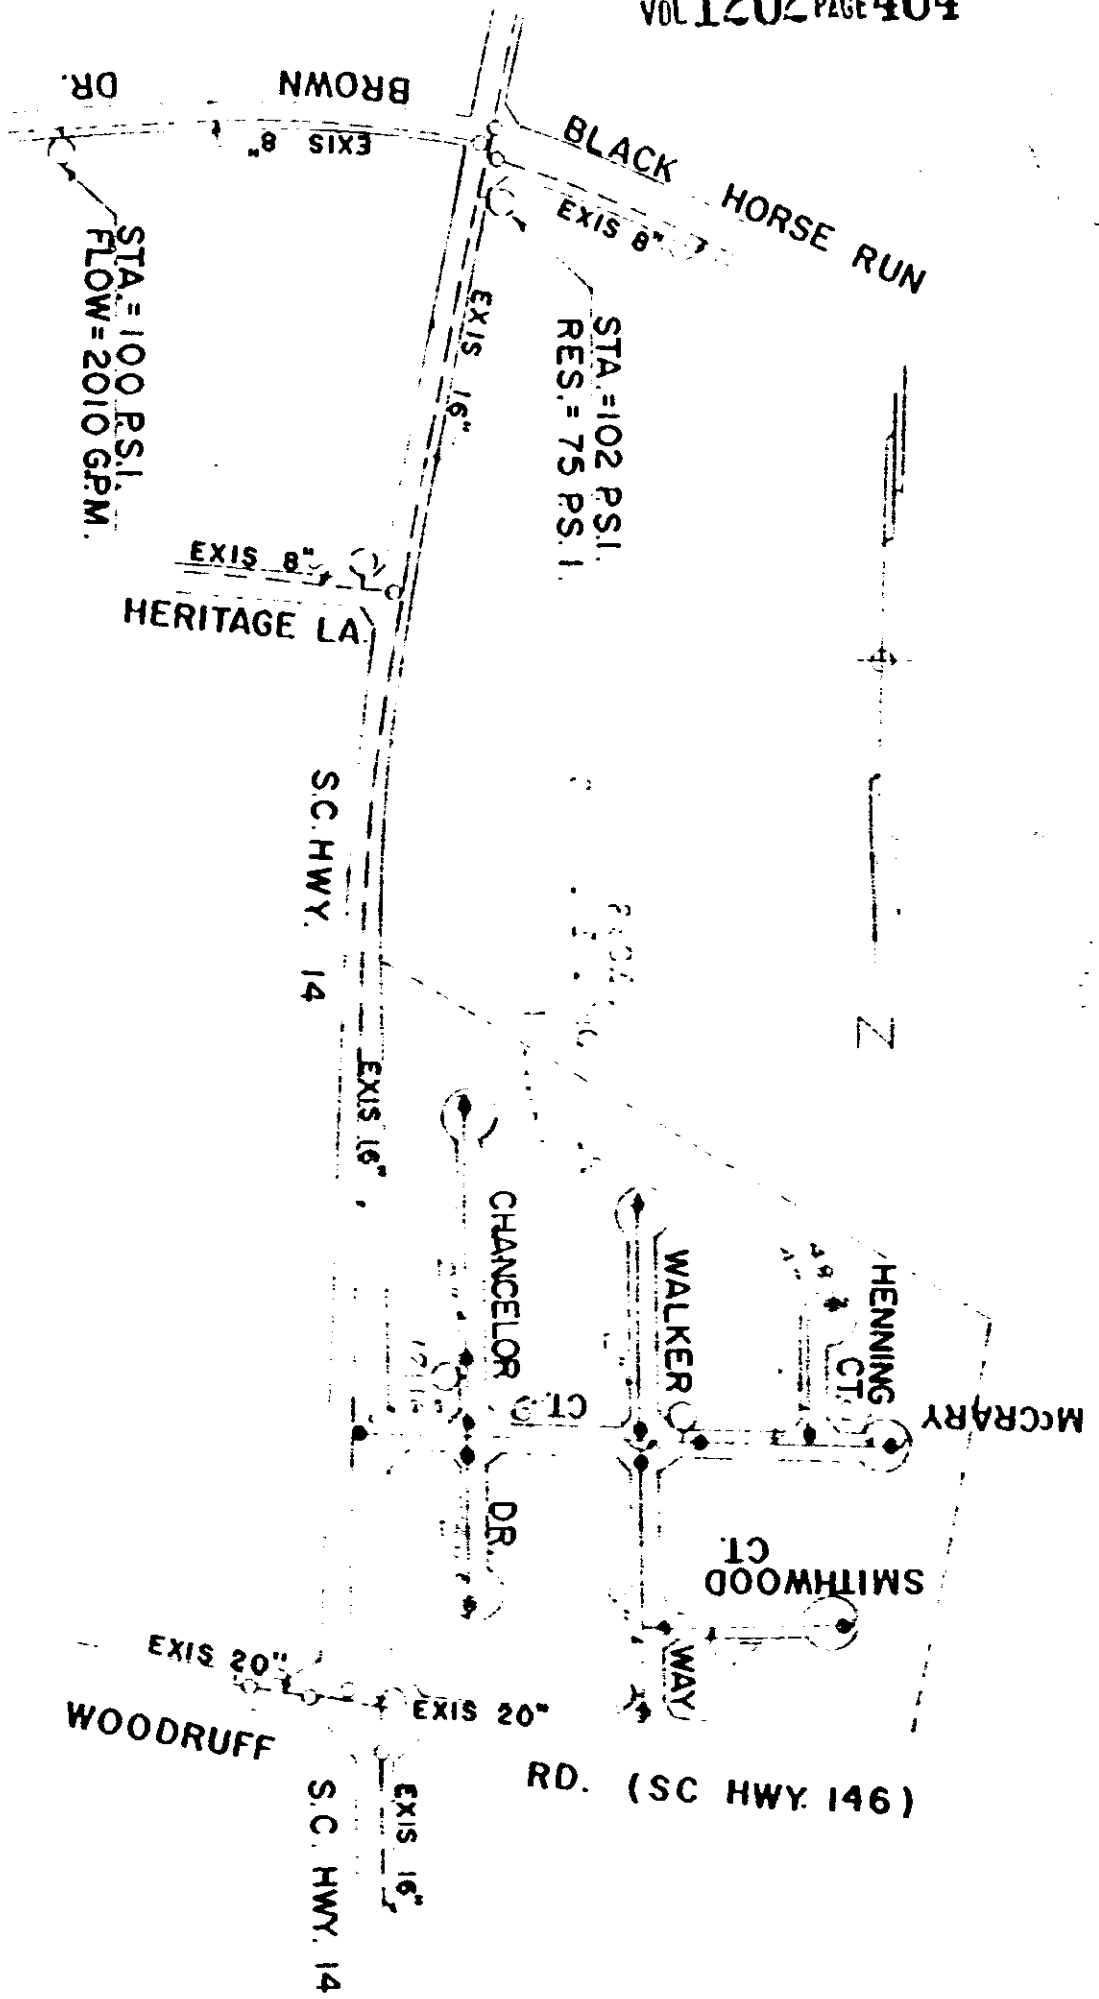

NOTE: 6" VALS. OPEN RIGHT  
 2" VALS. OPEN LEFT  
 FIRE HYDS. TO BE 3-WAY 8 OPEN RIGHT

Material List

6" D. I. Pipe	-	1,160'±
2" Galv. Pipe	-	2,470'±
6" Valves	-	6
2" Valves	-	14
Fire Hydrants	-	3
Valve Boxes	-	20

18920

WALKER ESTATES  
 DEC. 1982 SCALE 1" = 400'  
 REVISED SEPT. 1983

C & K Enterprises  
 to  
 Commissioners of Public Works  
 of the City of Greenville, S. C.  
 October 10, 1983  
 Block Book 539.3-1-14

RECORDED DEC 14 1983 at 10:31 A.M.

828-8287