


VOL 1203 PAGE 968

STATIC = 140 PSI.
FLOW = 1300 GPM.

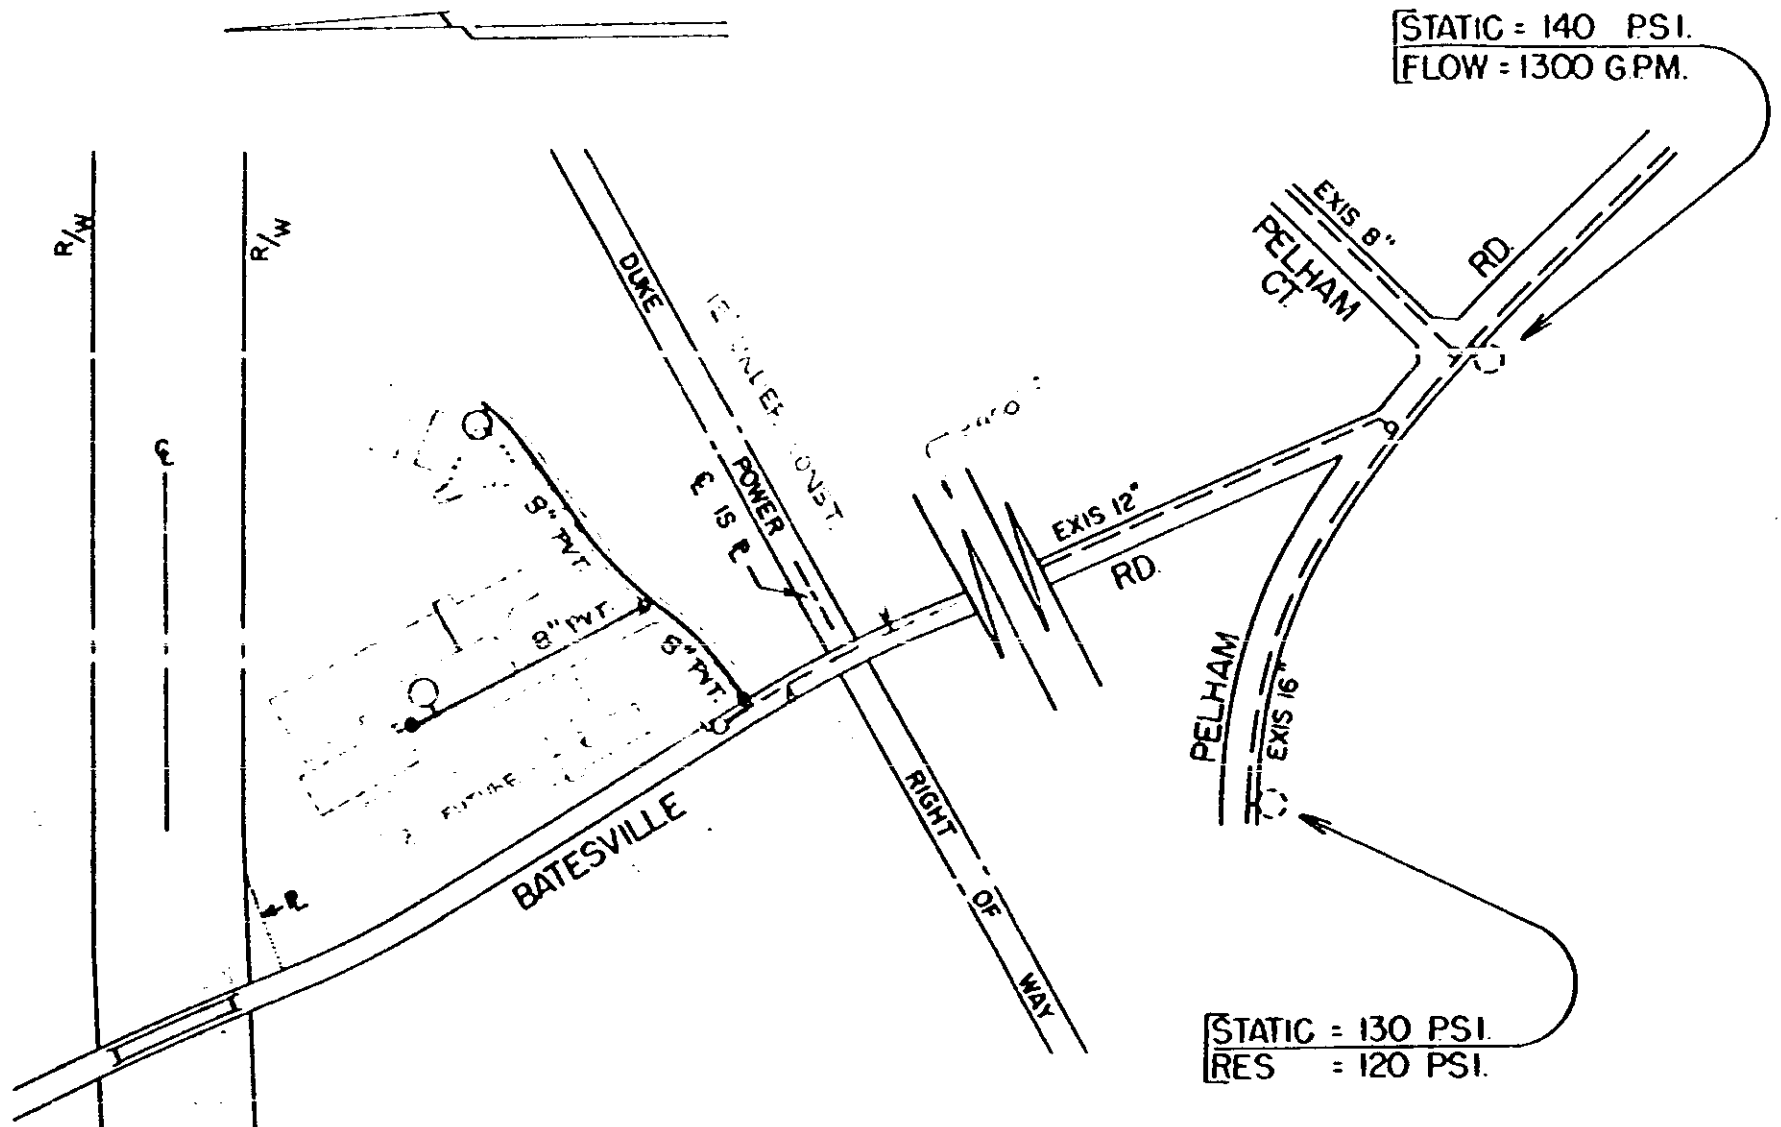

STATIC = 130 PSI.
RES = 120 PSI.

EASEMENT
 Ball Corporation, an Indiana Corporation
 to
 Commissioners of Public Works
 of the City of Greenville, S. C.
 November 11, 1983
 BLK. BOOK 530.5-1-20.1

NOTE: ALL 6" & 8" VALVES OPEN RIGHT.
2" VALVE OPENS LEFT.
FIRE HYDRANTS TO BE 3-WAY &
OPEN RIGHT.

BALL CORPORATION
 AUG, 1983 SCALE 1" = 400'

21327

RECORDED JAN 9 1984 at 9:25 A.M.

0968

21327