
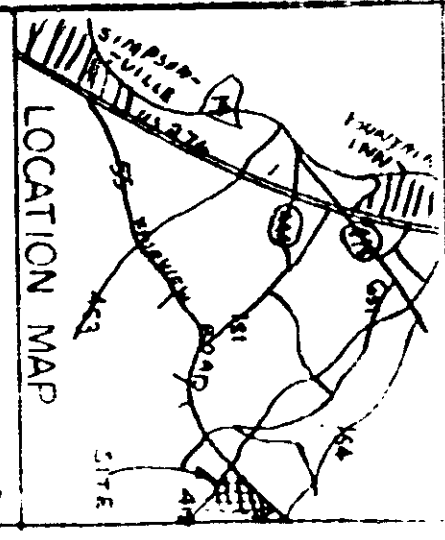


8 7 5 0

2-RV 8237

- MATERIAL LIST
- 2-3" GATE VALVES
 - 2-1 1/4" BOV.
 - 2-AIR RELEASE VALVES
 - 700LF.-2 1/2" PVC. 200 PSI WATERLINE
 - 4870LF.-3" PCV. 200 PSI WATERLINE

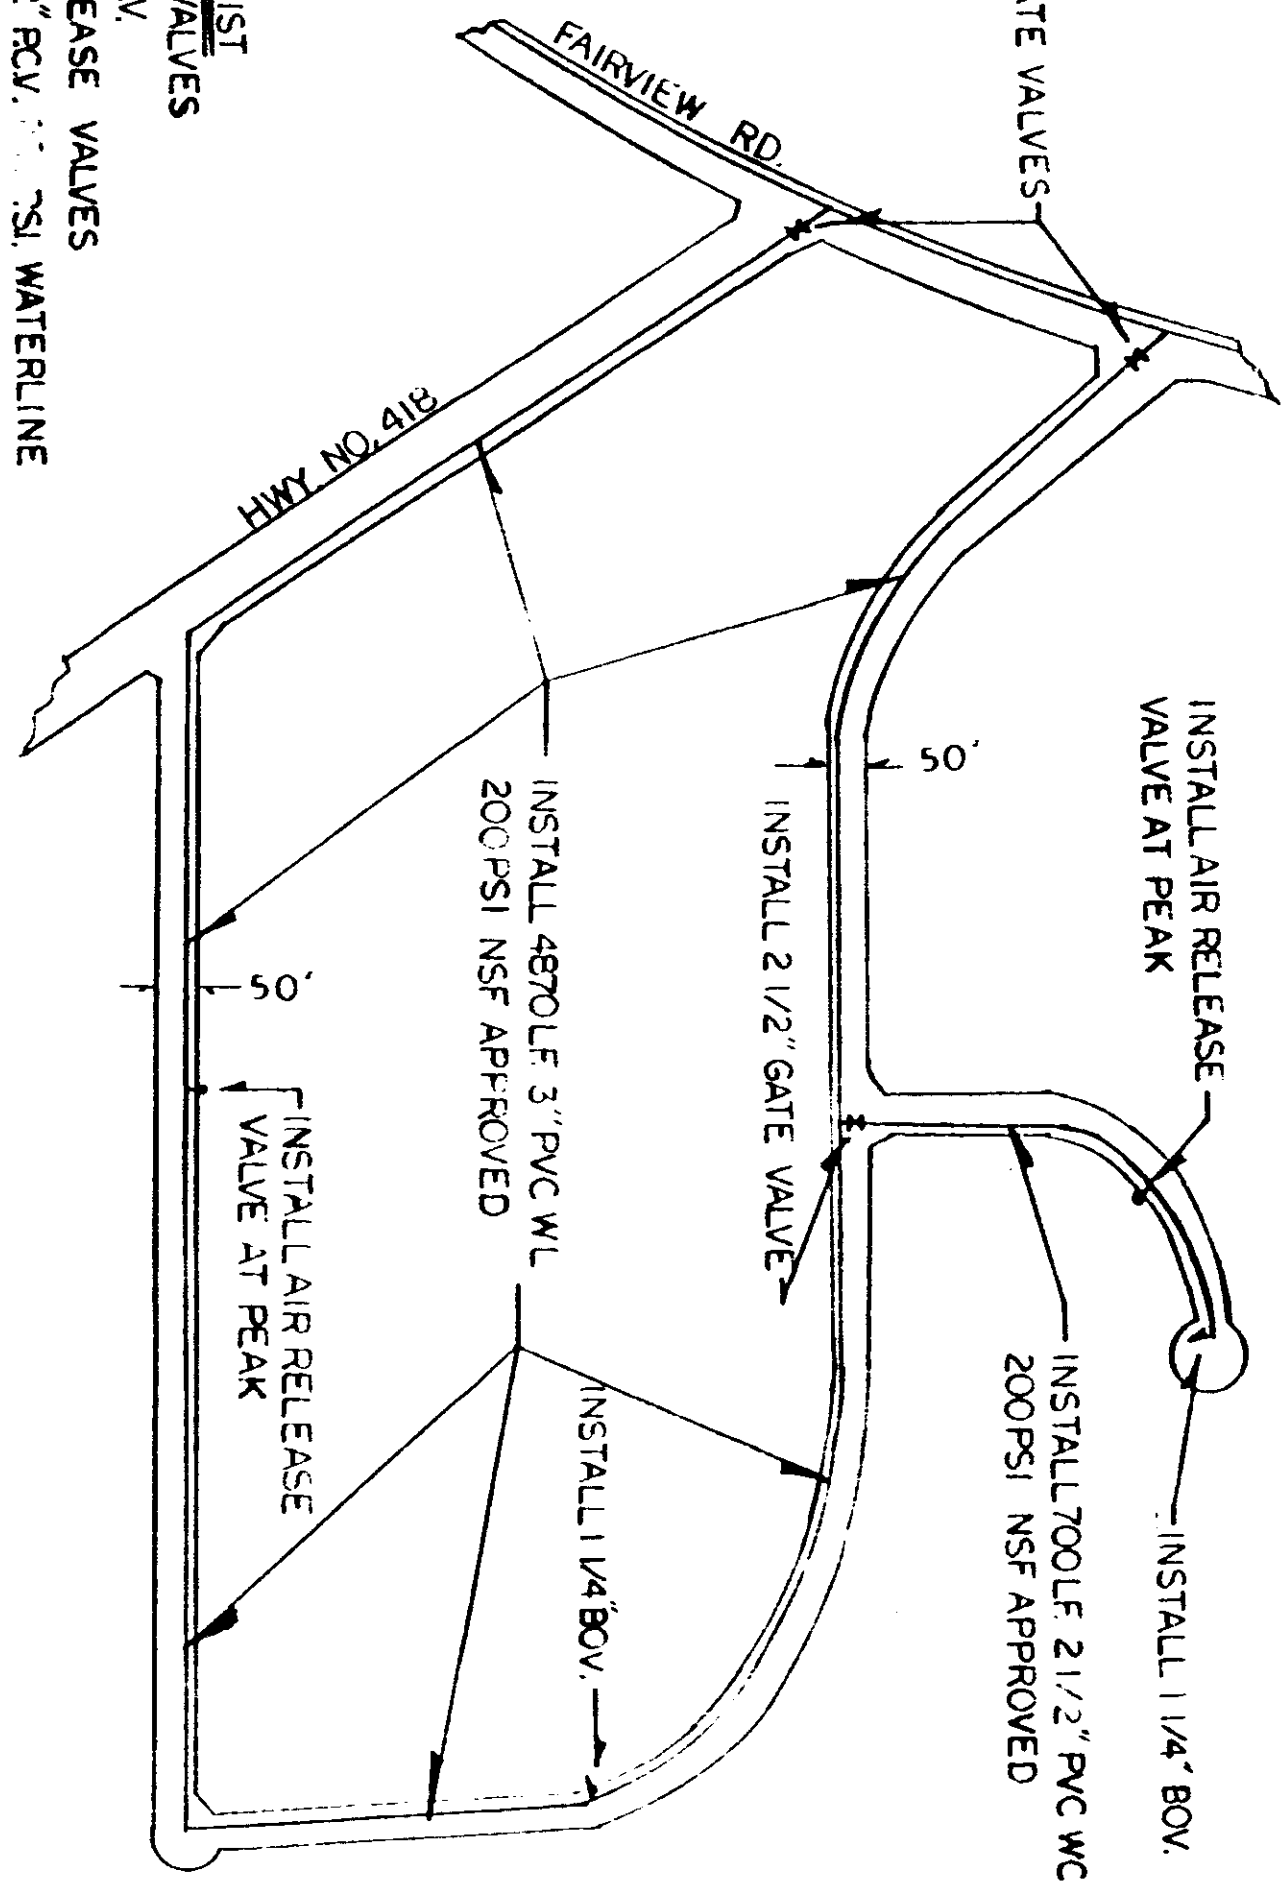

WILLIAM W. TEAGUE
 CONSULTING ENGINEER
 LAURENS, S.C.

DISTRIBUTION LINES OF
 A WATER SYSTEM
 FOR
 FAIRVIEW WOODS

SCALE: 1" = 300'	DR. NO.
DATE: 1/22/80	REV.
DR. BY: JB	

RECORDED MAR 6 1980 at 12:00 P.M.