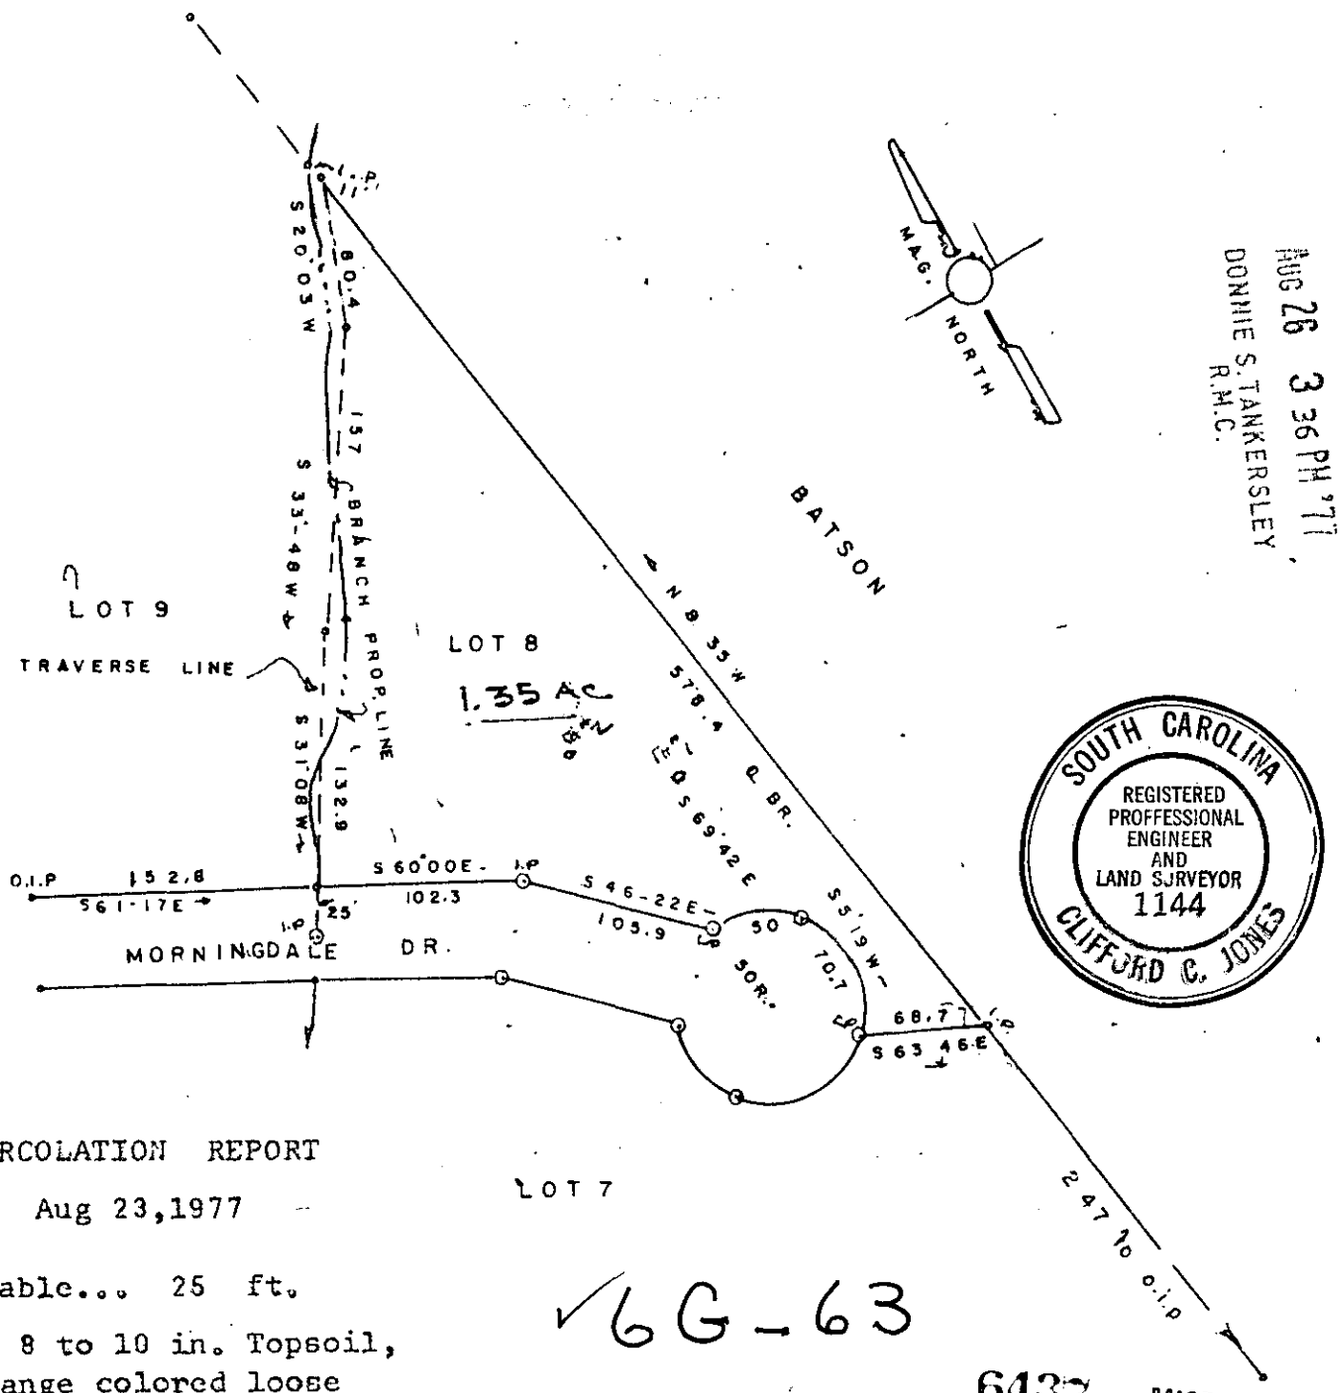

FILED
GREENVILLE CO. S.C.
AUG 26 3 36 PM '77
DONNIE S. TANKERSLEY
R.M.C.

SOUTH CAROLINA
REGISTERED PROFFESSIONAL ENGINEER AND LAND SURVEYOR
1144
CLIFFORD C. JONES

PERCOLATION REPORT

Aug 23,1977

Water Table... 25 ft.

Soil... 8 to 10 in. Topsoil, Orange colored loose sandy clay.

TEST RESULTS

HOLE	STABLIZED RATE
1	4.25
2	2.25
Ave. Rate	3.25

✓6G-63

6437

MICROFILMED

PROPERTY OF
PAUL A. PITTMAN
& DEBBIE G. PITTMAN
GREENVILLE CO. S.C.
Scale 1"=100 July 22.77

4 5 1 AUG 26E

1.00 A1

JONES ENGINEERING SERVICES